

Staff Paper Series

Economic Analysis:

Co-generation Using Wind and Biodiesel-Powered Generators

by

Douglas G. Tiffany

**DEPARTMENT OF APPLIED ECONOMICS
COLLEGE OF AGRICULTURAL, FOOD, AND ENVIRONMENTAL SCIENCES
UNIVERSITY OF MINNESOTA**

Economic Analysis:
Co-generation Using Wind and Biodiesel-Powered Generators

by

Douglas G. Tiffany

This research was funded by the Agricultural Utilization Research Institute (www.auri.org) and the University of Minnesota Agricultural Experiment Station.

The analyses and views reported in this paper are those of the author(s). They are not necessarily endorsed by the Department of Applied Economics or by the University of Minnesota.

The University of Minnesota is committed to the policy that all persons shall have equal access to its programs, facilities, and employment without regard to race, color, creed, religion, national origin, sex, age, marital status, disability, public assistance status, veteran status, or sexual orientation.

Copies of this publication are available at <http://agecon.lib.umn.edu/>. Information on other titles in this series may be obtained from: Waite Library, University of Minnesota, Department of Applied Economics, 232 Classroom Office Building, 1994 Buford Avenue, St. Paul, MN 55108, U.S.A.

Copyright (c) (2005) by Douglas G. Tiffany. All rights reserved. Readers may make copies of this document for non-commercial purposes by any means, provided that this copyright notice appears on all such copies.

ACKNOWLEDGEMENTS

The following individuals were very helpful with their explanations and generous with their time in helping us complete this project.

Al Tschapen, Minnkota Power, Grand Forks, ND

Ken Reiners, AgStar Financial Services, Hastings, MN

Jeffrey Haase, Minnesota Department of Commerce, St. Paul, MN

Mike Taylor, Minnesota Department of Commerce, St. Paul, MN

Michael Michaud, Humphrey Institute of Public Affairs, U of M, Minneapolis, MN

Paul Meyer, Ziegler Caterpillar Equipment, Shakopee, MN

Wynn Richardson, Department of Applied Economics, U of M, St. Paul, MN

Executive Summary

This study was undertaken to determine the economic feasibility of complementing electricity generated by wind with electricity generated by diesel gensets using various blends of biodiesel. An investment model was developed to estimate whether adding a genset, which increases the investment, revenue and operating costs will enhance the economic viability of generating electricity with a wind turbine. The investment model provides a tool that can be used to answer this question for sites with various wind characteristics and with alternative sources of revenue.

Existing regulations and tariffs in Minnesota and other parts of the U.S. establish preferences for power generated from wind and other renewable sources. The price typically paid for wind energy in Minnesota is \$.033 per KWH, but owners of wind turbines are eligible for several additional sources of revenue. The federal Production Tax Credit (PTC) of 1.9 cents per KWH is a second source. Utilizing this credit may require an investor/partner on a wind project with sufficient passive income tax liability to utilize this credit over the first ten years of the project. In addition, a Minnesota state incentive payment of 1.5 cents per kilowatt-hour is available for ten years on wind projects of 2.0 Megawatts or smaller, subject to statewide subscription levels. Production of electricity from wind may also result in the creation of tradable renewable credits or “green-tags,” which may have value to utilities subject to state renewable energy standards.

The variable nature of electrical power capacity from wind has been problematic for utilities, which try to meet the variable loads required by the summed demand of their customers. In addition to payments per kilowatt-hour produced by wind or other renewables, attractive capacity payments are offered by utilities when renewable sources can supply 65% “firm” power during “On-Peak” hours which are typically 9:00 a.m. through 9:00 p.m., Monday through Friday, excluding holidays for the months June through September.

The key task of this project is to determine if electricity derived from wind can be economically complemented with electricity generated by diesel generators or gensets using biodiesel, another renewable fuel. Biodiesel is a fuel that can be derived from vegetable oils or animal fats and can be used neat (100%) or in various blends with petro-diesel. With the passage of the Energy Bill of 2005, the federal biodiesel tax credit has the effect of lowering the price of biodiesel blends to the price of petro-diesel through 2008. Without the biodiesel tax credit in 2009 and beyond, the cost of B55 and B75 biodiesel blends (required to qualify as renewable power) will increase substantially. Electricity produced by diesel generators or gensets is typically much more expensive than electricity produced from wind or other sources; however, the electricity produced by the combination of wind and biodiesel generators may qualify as “firm” power and be eligible for capacity payments if considered a single “qualifying facility.”

Net present values (NPV) and internal rates of return (IRR) are calculated over the life of power production projects conforming to various conditions such as wind capacity factor, biodiesel costs, biodiesel blends utilized, and the number of hours required to back-up wind power. In addition the costs of electricity produced from wind alone and when complemented with a genset powered with various blends of biodiesel are calculated.

The analysis reveals that wind turbines with capacity factors 35% or better can be complemented with diesel gensets powered with B75 biodiesel to provide power 65% firm for June-September during on-peak hours and maintain overall IRR's greater than 9.0% as long as the Federal Biodiesel Tax Credit is in effect. Lacking the Biodiesel Tax Credit, wind sites with capacity factors of 40% can be expected to produce power and achieve a 9.0% IRR, when operating up to 651 hours per year using B75 blends with fuel priced at \$1.80 and \$2.60 for diesel and biodiesel, respectively. Complementing wind sites with diesel gensets does not make wind power more competitive on lower capacity factor sites. Hybrid systems using gensets powered with biodiesel blends should only be considered at sites with capacity factors above 35% and preferably 40%. The opportunity to firm power produced by wind may make further additions of wind power more attractive to power companies, although the creation of wind-biodiesel genset hybrids represents an untested concept as a "qualifying facility" in the regulatory framework.

Table of Contents

Executive Summary	ii
Table of Contents	v
List of Figures	vi
Introduction	1
Policy, Economic, and Technical Drivers of Wind Energy	2
Environmental Factors Favoring Wind Energy	3
Economic Issues Facing Wind Energy	4
Objectives	7
Literature Review	8
Background and Methods	9
Wind Energy and Sites for Wind Turbines	9
Operation of Wind Turbines	12
Discussion of Capacity Factors	13
Operations of Diesel Gensets	13
Overview of Wind-Genset Workbook	14
Data Sources	15
Discussion of Wind Data	15
Analysis of Hourly Wind Production Data	18
Measurement of On-Peak Gaps	23
Capital Costs of Wind Turbines	24
Operating Costs of Wind Turbines	24
Discussion of Diesel Gensets	25
Capital Costs of Diesel Gensets	25
Operating Costs of Diesel Gensets	25
Assumptions	
Electrical Revenue, Rules and Tariffs	26
Biodiesel Blend Levels in Cogeneration under PURPA	27
Costs of Diesel and Biodiesel	27
Analysis	31
Results of Analysis	36
Production Economics of Wind Turbines Alone	36
Production Economics of Diesel Gensets Alone with Biodiesel Credit	37
Production Economics of Hybrid System with Biodiesel Tax Credit	39
Production Economics of Hybrid System without Biodiesel Tax Credit	42
Conclusions	44

List of Figures

Figure 1	U.S. Installed Wind Generating Capacity in MegaWatts	1
Figure 2	Sources of U.S. Electrical Power in 2004	2
Figure 3	Pounds of Emissions per KWH of Electricity Generated in U.S.	3
Figure 4	Levelized Electricity Costs for New Plants 2015	4
Figure 5	Theoretical Factors of Wind Power Available to be Harvested	10
Figure 6	Minnesota's Wind Resource by Wind Power at 70 Meters	11
Figure 7	Power Production for Wind Speeds of NEG Micron 1.65 MW Wind	12
Figure 8	Monthly Wind Power Production at Valley City and Petersburg, ND	16
Figure 9	2004 Monthly Statistics Infinity at Valley City and Petersburg, ND	17
Figure 10	June 2003 Hourly On-Peak Power Production from Wind	19
Figure 11	July 2003 Hourly On-Peak Power Production from Wind	20
Figure 12	August 2003 Hourly On-Peak Power Production from Wind	21
Figure 13	September 2003 Hourly On-Peak Power Production from Wind	22
Figure 14	Hours of Genset Operation at Nameplate	23
Figure 15	Price of No. 2 Diesel Fuel in Minnesota Excluding Tax	28
Figure 16	Biodiesel Costs Based on Soybean Oil Costs with Credit for Glycerol	29
Figure 17	Projected Production Costs for Diesel Fuel by Feedstock	30
Figure 18	Wind Turbine Production Economics	34
Figure 19	Diesel Genset Production Economics	35
Figure 20	Financial Performance of 1.65 MW Wind Turbine	36
Figure 21	Internal Rates of Return for Wind Sites with Capacity Factors	37
Figure 22	Cost Per KWH of Electricity Produced by Diesel Genset	38
Figure 23	Internal Rate of Return for Various Hours of Diesel Genset Operation	38
Figure 24	Cost Per KWH of Electricity Produced by Diesel Genset	39
Figure 25	Financial Performance of Wind Turbine on 30% Capacity	40
Figure 26	Overall Financial Performance of Wind Turbine on 35% Capacity	40
Figure 27	Financial Performance of Wind Turbine on 40% Capacity	41
Figure 28	Financial Performance of Wind Turbine on 45% Capacity	42
Figure 29	Financial Performance of Wind Turbine on 35% Capacity	43
Figure 30	Financial Performance of Wind Turbine on 40% Capacity	43
Figure 31	Financial Performance of Wind Turbine on 45% Capacity	43

Introduction

Electrical generation capacity from wind has grown rapidly in the U.S. in recent years as reflected in **Figure 1**. Despite the rapid growth and high visibility, wind remains a small portion of total electrical energy consumed in the U.S., as shown in **Figure 2**. In reviewing this data, it is important to distinguish between capacity to produce power and the actual production of power. U.S. and Minnesota wind capacity has been developed in response to the federal production tax credit (PTC), which currently offers ten years of income tax credits that can be applied toward passive income. Additional state incentives such as the Minnesota Wind Production Incentive for small wind projects (less than 2.0 MW), and Minnesota statutes that compel Xcel Energy to purchase targeted quantities of renewable energy have encouraged wind development in Minnesota.

Figure 1.


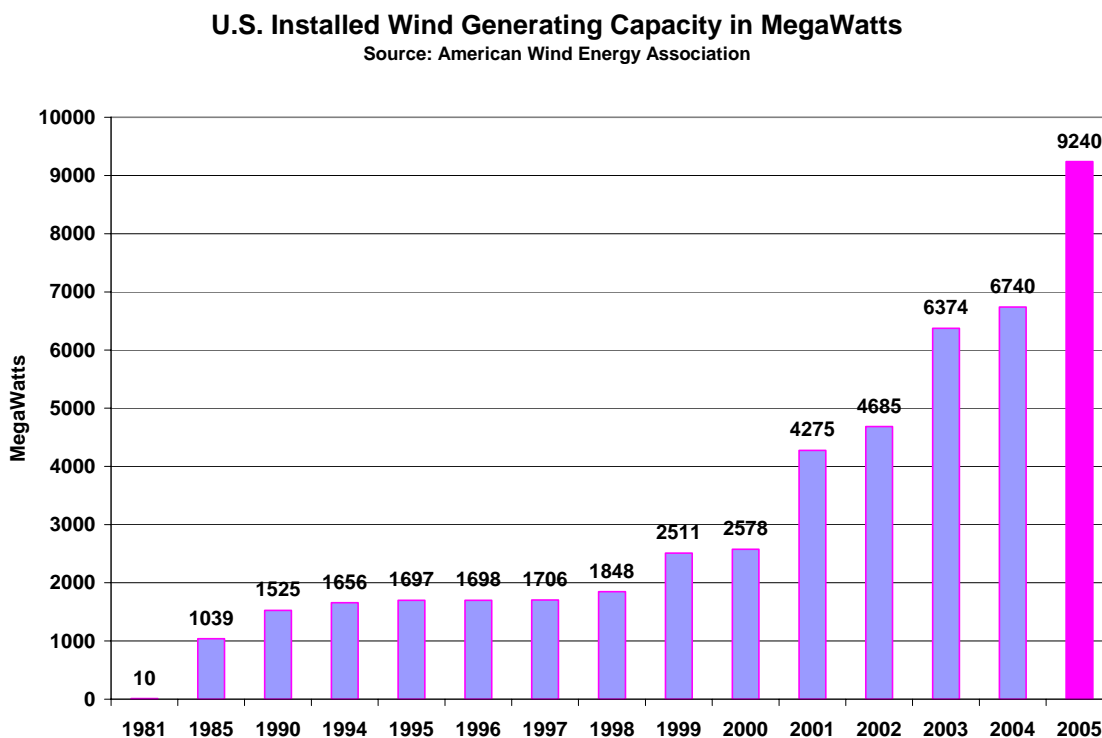


Figure 2.

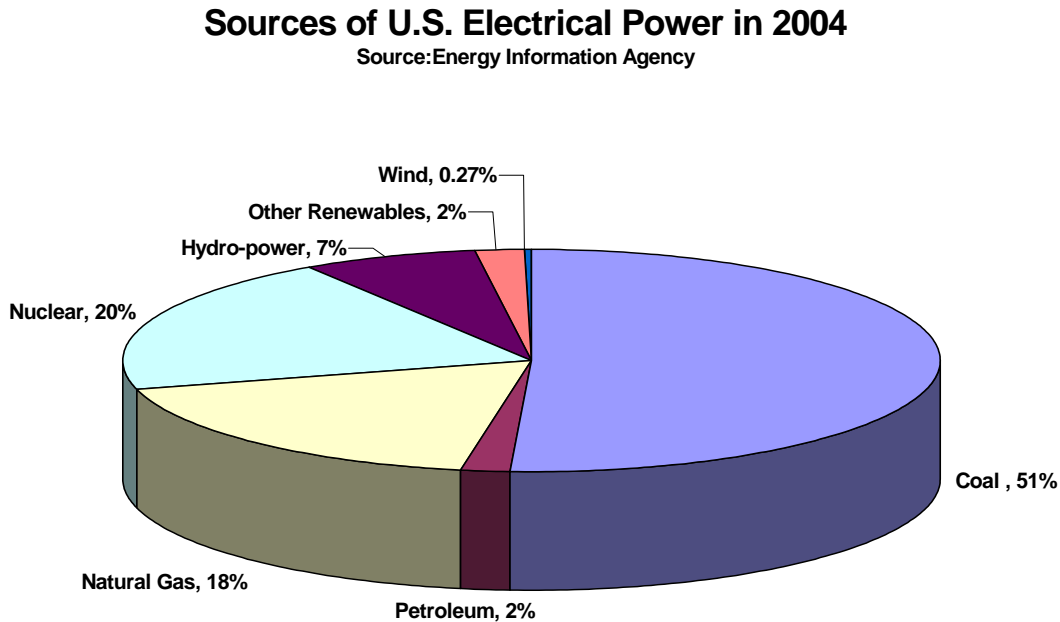

Policy, Economic, and Technical Drivers of Wind

Wind electrical generation capacity in Minnesota has been assisted by the interplay of state and national factors starting with policy drivers, which are closely related to economic incentives, and then improvements in knowledge and equipment. The following listing segregates and highlights the importance of some of these factors currently and in the future:

Policy Drivers

- 1) Public Utilities Regulatory Policy Act (PURPA) legislation that requires utilities to accept wind and other renewable sources of electricity at “avoided costs,”
- 2) Federal Energy Regulatory Commission (FERC) policies that foster greater access to the grid by renewable energy,
- 3) Strong interest shown by individuals and groups to support the establishment of renewable power sources, including wind,
- 4) State goals to mandate local wind energy and other renewable energy sources versus purchases of electricity derived from fossil fuels or from other states or nations and
- 5) Investigation of regulatory barriers that reduce utilization of windpower.

Economic Drivers

- 1) U.S. policy establishing and maintaining the wind production tax credit (PTC), now extended through 2007 at 1.9 cents per kWh for ten years of production,
- 2) State of Minnesota Wind Incentive payments of 1.5 cents for ten years of production of projects less than 2.0 MW in size,
- 3) Growth in experience by bankers in financing wind energy development projects,
- 4) Experience in marketing wind-derived energy in response to corporate goals and consumer demand for “green” energy and
- 5) Growth in experience by lawyers in negotiating and executing power purchase agreements between wind producers and utilities.

Technical Drivers

- 1) State of Minnesota’s public investments to assess wind resources around the state,
- 2) Increasing sophistication in design and engineering of wind turbines; especially international experience in Germany, Denmark, and Spain, and
- 3) Greater research in conductors capable of increasing capacity in transmission lines from remote wind sites to load centers.

Environmental Factors Favoring Wind Energy

The various drivers cited above are strengthened by wind-derived electricity’s reputation as a clean source of electrical power. If national policy or international policies should emerge that favor the reductions in greenhouse-producing gases, windpower will certainly gain due to potential charges on emissions from fossil sources or corresponding increases in “green” energy credits. Appearing below in **Figure 3** are the amounts of carbon dioxide, sulfur dioxide, and nitrogen oxides released in the process of producing a kilowatt-hour by various methods.¹

Figure 3.

Pounds of Emissions per KWH of Electricity Generated in U.S.

Source: EIA Annual Energy Review 1998

Fuel	CO2	SO2	NOx
Coal	2.13	0.013400	0.0076
Natural Gas	1.03	0.000007	0.0018
Oil	1.56	0.011200	0.0021
U.S. Average Mix	1.52	0.008000	0.0049
Wind	0	0	0

¹ Wind Energy Fact Sheet, American Wind Energy Association, EIA Annual Energy Review 1998. <http://www.eia.doe.gov/aer>

Economic Issues Facing Wind Energy

Despite the favorable influences and drivers that have hastened the growth in wind energy in recent years in Minnesota, there are substantial economic issues that must be surmounted before greater portions of total electrical capacity can be replaced by wind.

Key among the problems is the economic inertia that faces any alternative energy source. An operating system exists that functions very efficiently and supplies electricity very cheaply. Tremendous investments have been made by utilities to supply homes, commercial enterprises, and industries with the amount of energy needed, when it is needed. Power-generating facilities, whether coal-fired or nuclear are located at strategic locations to produce power that can be readily distributed through the continental electrical grid from the sources where produced to the places where needed. The firms generating electricity from conventional sources and transmitting that power have obvious self-interests to protect their investments in installed capacity.

Electricity is unique as a commodity because of its inherent property of flowing to sites where demanded and at the speed of light. The North American electrical grid permits utilities to automatically bid and receive power from the lowest cost supplier in real time. Few other commodities that improve the quality of life have these inherent qualities or are available in such a market. Because this market and the North American grid permit the sale of power at favorable prices, it is often difficult for renewable sources, such as wind, to compete against cheap coal and conveniently located natural gas powered generators. **Figure 4** allows one to compare the relative costs per kilowatt-hour of electricity generated by various fuels and by wind as projected by the U.S. Energy Information Agency for 2015.

Figure 4.

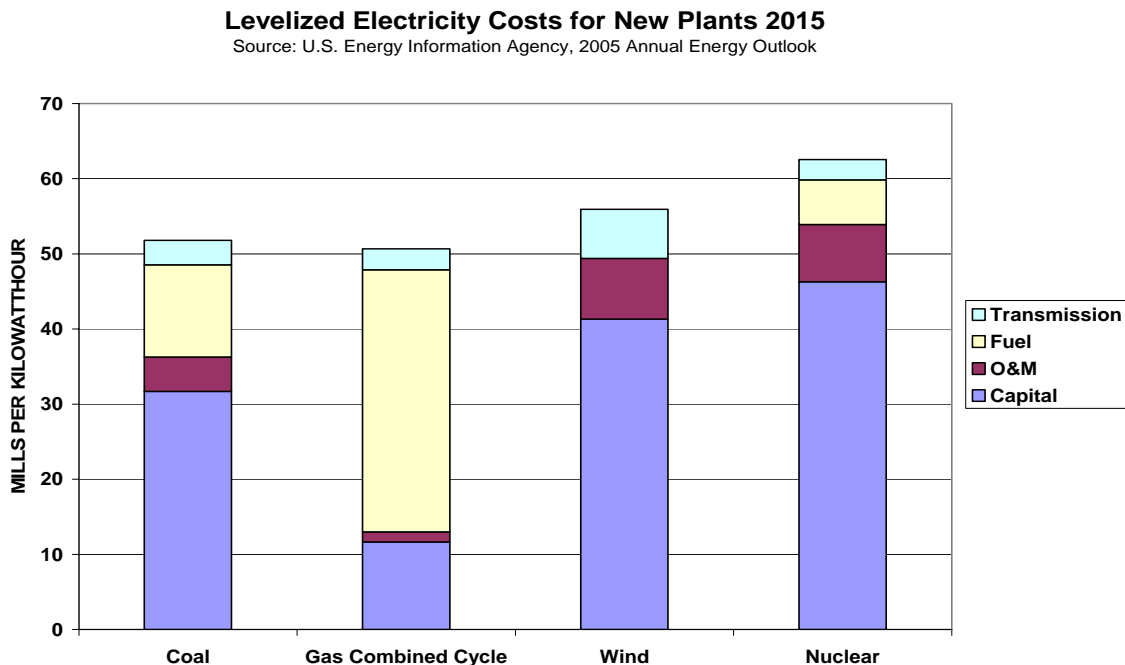


Figure 4 shows that natural gas used in a combined cycle generator has the lowest levelized cost per kilowatt-hour, and lowest capital costs, but costs for this source of power have the highest fuel cost component. Mistaken assumptions about natural gas costs over the next ten years could easily reverse these rankings. Coal-fired generators produce power with slightly higher overall costs than natural gas, but have capital costs nearly three times greater and with much lower cost for fuel than natural gas. The levelized cost of electricity derived from wind has higher capital cost per kilowatt-hour produced than both coal and natural gas with operations and maintenance expenses approximately twice as high as coal. Windpower has no fuel cost, but transmission costs are higher due to the fact that the best wind resources in the U.S. are generally quite distant from load centers. Nuclear power plants have the highest levelized cost due to higher capital costs than wind, similar O & M expenses as wind, modest fuel costs and transmission costs intermediate between natural gas and coal. A conclusion to be drawn from this generalized outlook is the competitiveness of wind in producing electricity versus coal and natural gas. Each of the four sources of power has its particular challenges. Natural gas has recently faced fuel cost volatility. Coal requires much higher capital costs due to necessary scrubbers and uses a fuel that contributes higher emissions of carbon than the other choices. Wind has high up-front capital costs and higher transmission costs than the major alternatives compared. Nuclear power plants face high capital costs due to safety requirements as portrayed in the graph as well as potentially legal and regulatory battles in siting future plants.

Electricity has a fundamental problem as a commodity in that it needs to be generated concurrently with its use. Technologies to store electricity, such as batteries, are undeveloped or too expensive to overcome the need to produce power as needed. Liquid fuels and natural gas can be cheaply transported by pipelines. Liquid fuels can be stored in tanks where needed; and natural gas can be pressurized and stored in caverns until needed. In contrast, electricity must be generated in the right amount at the right time to fulfill the requirements of the aggregated end users, who just flick a switch to receive more. Tremendous investments have occurred to balance the supply of electricity available in the North American electrical grid with computers and other equipment that prompt numerous generators to produce the proper amount of electricity at the right time.

A satellite view of Minnesota reveals a network of railroads that transport low-sulfur coal to some large electrical generating plants. A similar view would show a pipeline system that transports natural gas from Canada and the Gulf States to Minnesota generators using this fuel. In addition, transmission lines from mine-mouth coal plants in North Dakota and Wyoming provide a significant portion of the electricity available for Minnesota users. Transmission lines are also important in transporting hydro-electric power from Ontario and Manitoba to Minnesota. Minor amounts of hydro-power and other renewable sources of electricity exist in Minnesota with the exception of wind.

In addition to facing economic inertia in markets supplied by mature technologies that supply their customers quite cheaply, wind power has two problems that are uniquely its own.

- 1) Wind and electrical power derived from it is a variable “flow resource.”
- 2) Because such a small proportion of electrical power demand occurs in the areas of Minnesota and neighboring states with the best wind resources, constraints on transmission capacity and existing rules limit access for wind on the transmission grid.

It is with this background that this project was initiated to investigate a means by which the wind resources of Minnesota can be more fully utilized in a fashion compatible with power demand.

Objectives

This project was proposed in order to assess the economic feasibility of complementing variable, renewable electricity from wind with largely renewable “dispatchable” electricity generated by diesel generators or gensets. As proposed, the gensets would be fuelled with various blends of biodiesel, a renewable fuel with an excellent energy balance and emissions characteristics more favorable than petro-diesel. The primary objectives of this project were to determine the financial performance and blended cost of the energy from wind turbines complemented with biodiesel-powered gensets. Fundamental to this purpose was the understanding of the applicable rules for pricing and accepting electricity supplied by wind and other renewable sources of energy on the transmission grid. Power purchase tariffs recorded by Xcel Energy with the Minnesota Department of Commerce offered guidance on potential payments for power produced as well as payments for capacity. Development of capital and operating costs for wind turbines and gensets using biodiesel blends preceded analysis with an investment model.

Literature Review

The study in rural Texas² by Eggleston and Clark demonstrated use of a small wind generator to supplement power provided by a diesel generator. The diesel generator used either #2 diesel or biodiesel as fuel. The research was directed toward learning the ability of wind to save fuel in diesel generators dedicated to power production in a village situation. The researchers found that 5.4% more biodiesel than #2 diesel was needed on average per kilowatt-hour. This hybrid system resulted in 18% fuel savings over 800 hours of testing.

A multi-year project in the remote village of Wales, Alaska by National Renewable Energy Laboratory (NREL) researchers, Drouilhet and Shirazi³ sought to determine the economics of using wind to reduce fuel usage and cut costs in a village totally reliant upon on-site electrical generation by diesel. Because of its remote location, the delivered cost of diesel fuel was very high, ranging from \$1.00 to \$3.00 per gallon, making for very expensive electricity. Equipment for this village of 160 people and an average electric load of 75 kW included two wind turbines totaling 130 kW and three diesel gensets totaling 411 kW. In addition this project included substantial batteries, a battery charger, a rotary converter and also local and remote dump load controllers in order to have greater control over the power output from the various sources. Much of the research was directed toward determining statistical measures to guide management of the various components of this system at various times and balance the system to the load.

The third key study reviewed was by McGowan, et al⁴ and involved the pending installation of four turbines of approximately 4.0 MW to supplement 15 diesel gensets providing up to 22.8 MW diesel electricity plant at Guantanamo Bay, Cuba. Hybrid2 software was used to estimate the potential contribution of the wind turbines to the base's energy needs as well as the cost savings of very expensive diesel fuel delivered to this location. In addition, the researchers were interested in avoiding substantial emissions of NO_x, SO_x, CO₂, and particulates. Average full-load fuel use in the diesel engines typically used (ranging from 900 kW to 2500 kW) was 80 gallons per MWh or about 30-32% efficiency. One conclusion of the study is that when wind penetration increases, greater savings can occur in diesel fuel; however, more complex controls and expensive equipment will be needed. At peak power output the wind turbines will produce from 20-25% of the base's electric demand and displace the greenhouse gas emissions of over 13,000,000 pounds of carbon dioxide from the diesel generators. Installation of the four turbines at Guantanamo Bay makes this base the world's largest wind-diesel hybrid utility.

² Eggleston, Eric and R. Nolan Clark, "Wind/Diesel and Wind Biodiesel Performance of the USDA Hybrid System," USDA, Agricultural Research Service. 1998.

http://www.biodiesel.org/resources/reportsdatabase/reports/gen/19980601_gen-268.pdf

³ Drouilhet, S and M. Shirazi, "Wales, Alaska: High-Penetration Wind-Diesel Hybrid Power System," National Renewable Energy Laboratory, NREL/TP-500-31755, May 2002.

⁴ McGowan, et. al. "Wind Power at Guantanamo Bay: A Hybrid Wind-Diesel System," University of Massachusetts, Renewable Energy Research Laboratory, Amherst, MA. Presented at American Wind Energy Association's Global Windpower 2004 Conference. March 30, 2004.

Background and Methods

The amount of electricity generated and the profitability of investing in a combination wind turbine and genset is highly dependent on the wind energy available at the site selected. As we show later in this paper, the cost of producing electricity with a genset is typically greater than the cost of producing electricity with a wind turbine. Investors want to select a site with wind characteristics that enable the turbine to provide power during a high proportion of the on-peak hours (typically 9:00 a.m. to 9:00 p.m. Monday through Friday during June through September). With more hours of turbine operation, fewer hours of genset operation are required to provide 65% firm power during the on-peak hours and qualify for capacity payments.

Some of the considerations in site selection, operation of wind turbines and operation of diesel genset operation are mentioned here as background for the analysis. Then it is time to describe the analytical tool selected to determine how well biodiesel-powered gensets can complement wind turbines.

Wind Energy and Sites for Wind Turbines

Wind turbines are designed to convert the kinetic energy of wind moving its blades into direct current electrical power. The formula for the power of wind in English units appears below⁵:


$$\text{Power} = 1/2 \rho A V^3$$

where ρ is air density
 A is swept area of blades
 V is wind velocity

Because the power available to generate electricity is a function of wind velocity cubed, relatively small increases in wind velocity result in substantial increases in power available to move the blades of a turbine. This factor in the formula makes selection of wind development sites with the highest possible annual wind velocity such a critical activity. **Figure 5** shows the theoretical factors of increase in power above that at 15 miles per hour in the area swept by a wind turbine for higher wind velocities. This helps explain why individuals and firms developing wind sites go to considerable expense and perform detailed analysis to select sites with the best possible wind velocities in an area. One can see from this graph that a site with a wind velocity of 17 mph is approximately 50% better than one with a wind velocity of 15 mph. Similarly a site with wind velocity of 19 mph should have twice the power of one with 15 mph. The term for air density in the formula tells us that cooler, denser air is capable of moving the blades of a wind turbine to a greater degree than warm air. One should remember that wind turbines can not be designed to capture very high portions of the theoretical power in the wind, but must always allow a certain volume of wind to pass by the turbine blades.

⁵ "Wind Energy Manual." Iowa Energy Center, 2000, p. 11. Website: http://www.energy.iastate.edu/renewable/wind/wem/wem-01_print.html, viewed 10/27/2004

Figure 5.

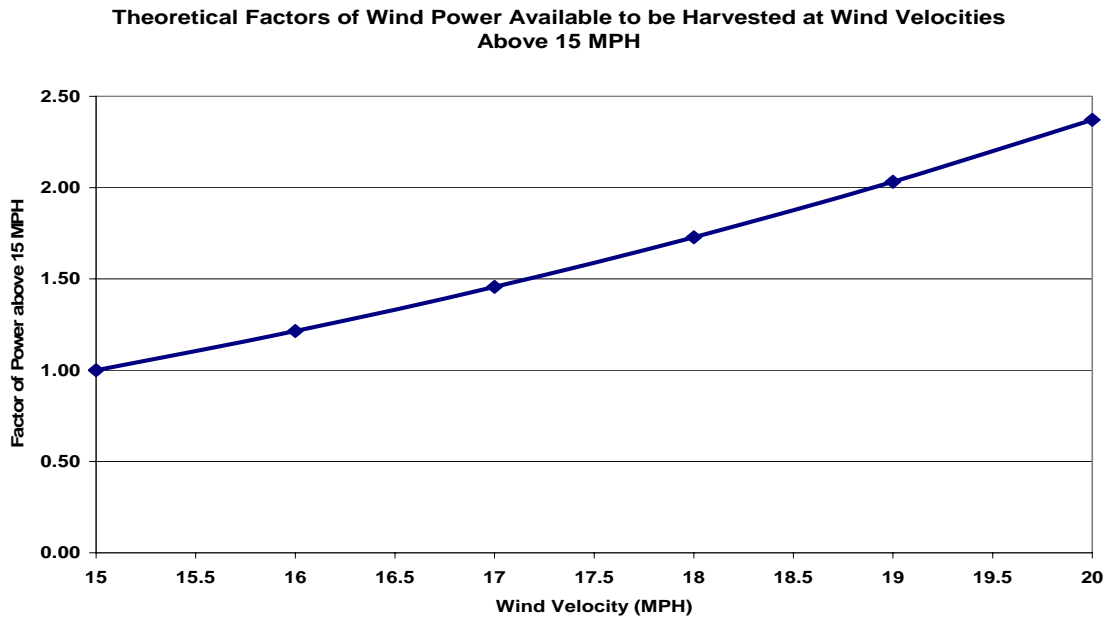


A site with favorable wind velocity also needs to be located in an area with access to the power grid. To develop a successful wind energy project, additional effort and expense must be made to determine favorable locations, as will be discussed further in a section of this paper discussing the capital costs of wind turbines.

Wind developers are like mineral prospectors to the extent that they study maps and gather data in order to find sites that have the most reliable wind resources of sufficient strength to be utilized. The map on the following page, **(Figure 6)** shows in a generalized fashion, the wind power levels for Minnesota. The Minnesota Department of Commerce directed the development of this map following the collection of massive amounts of wind data. This map and other related public expenditures have certainly enhanced wind project development in Minnesota. The units mapped are in Watts per square meter of swept area of wind turbine blades at a hub height of 70 meters, which is a typical height for many modern, utility scale wind turbines.

Figure 6.

Minnesota's Wind Resource By Wind Power at 70 Meters

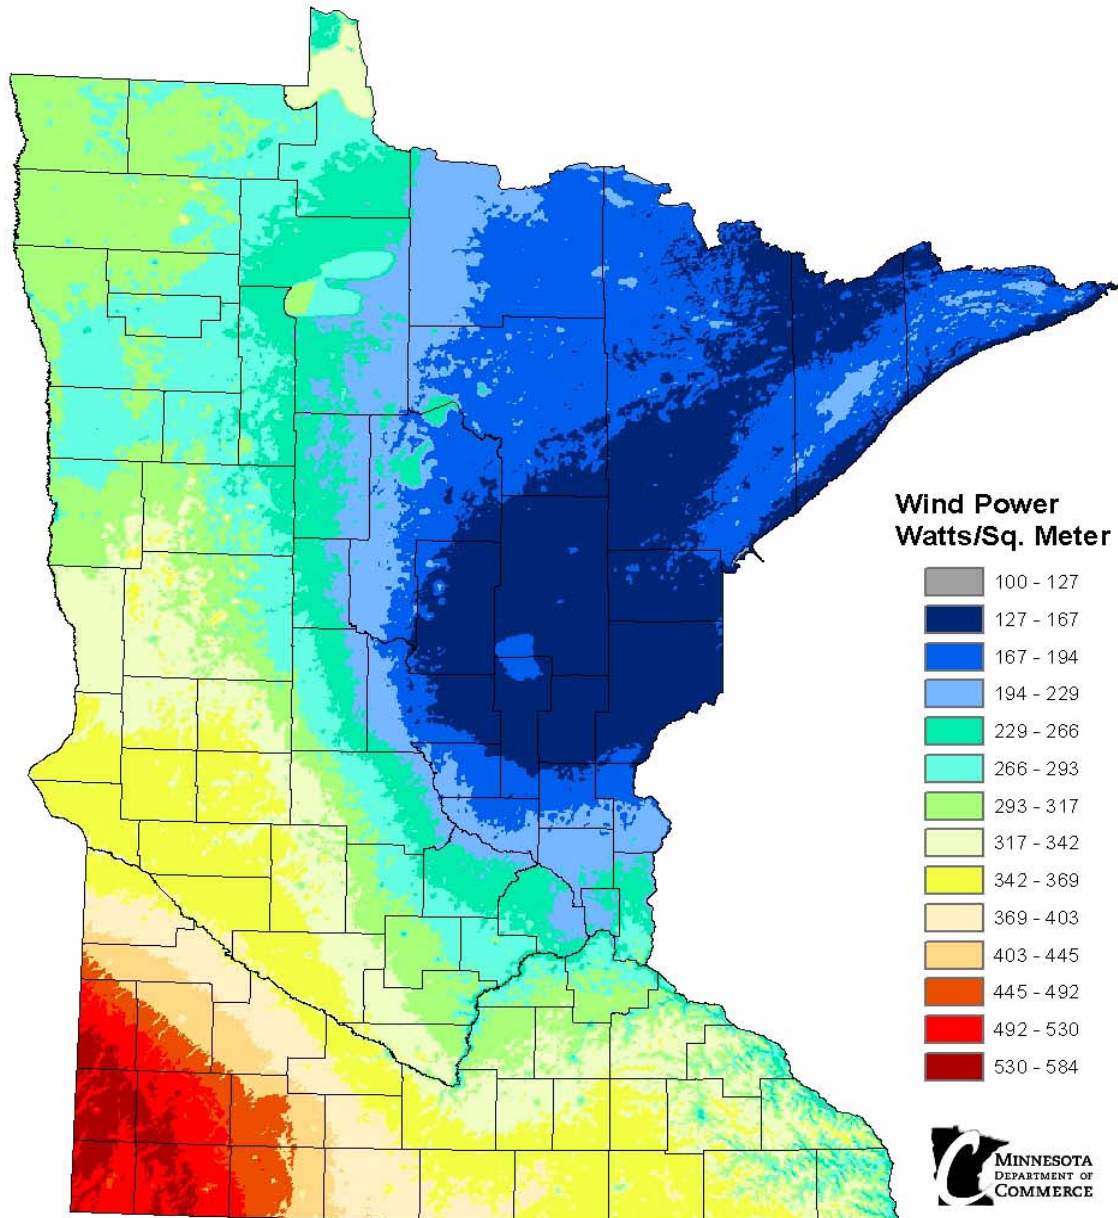

The Department of Commerce prepared this map using the WindMap program, which takes into account wind data, topography, and land use characteristics. Data is averaged over a cell area 750 meters square, and within any one cell there could easily be features that could increase or decrease the results shown on this map. Regions with the greatest concentrations of monitoring sites show the most accurate results. This map shows the general variation of Minnesota's wind resource and should not be used to determine the performance of specific projects.


June 2002

Operation of Wind Turbines

All wind turbines that have been built have a power curve, which represents the ability of that particular design to convert the kinetic energy of wind into electrical power.

Figure 7 shows the power levels a specific wind turbine model is capable of producing at various wind speeds. Consideration of the relationship between wind speed and power generated helps one understand the importance of designing turbines capable of producing power at low wind speeds as well as the ability to keep producing energy at high wind speeds. In recent years the major wind turbine manufacturers have been able to improve (lower) the wind velocity when a wind turbine reaches maximum power.

Figure 7.

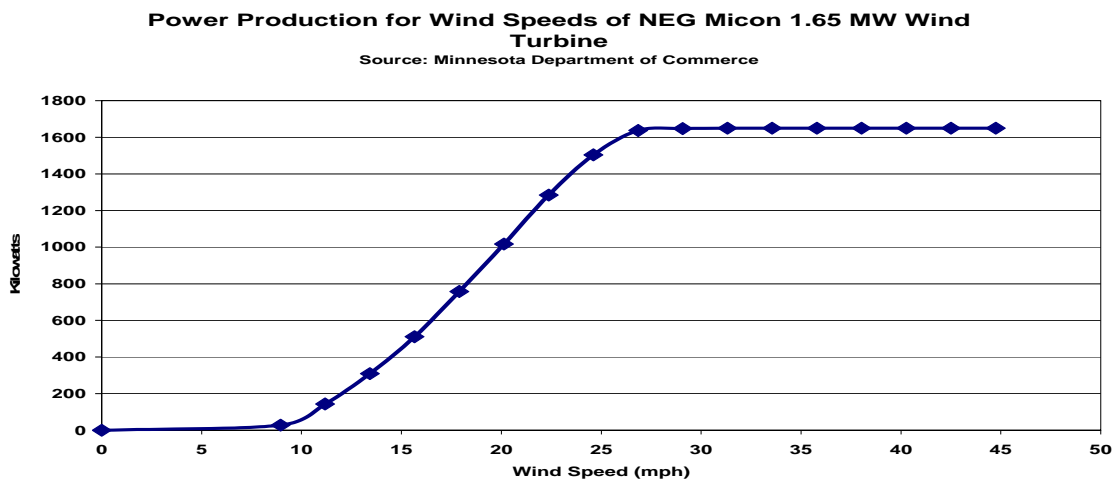

Several points about the power curve are important for our analysis. Below certain wind speeds, no electricity is produced. The minimum wind velocity that can produce electricity is called the “cut-in” velocity, which is shown as 10 miles per hour on the graph above. The turbine blades turn at speeds from 14 to 29 revolutions per minute, depending upon the model. At higher wind speeds, power output increases until the nameplate output capacity is reached at 1.65 Megawatts. As the graph shows, the output will stay at the same output level with higher and higher wind speeds until a cut-out speed is reached. The cut-out wind speed is often around 55 to 65 mph on many models and is the point where the wind turbine sets a brake to bring the blades to a stop for protection. In addition, the blades are rotated 90 degrees out of the wind and parked. After the wind drops back below cut-out velocity as detected by the on-board anemometer for a designated period of time, the turbine’s yaw control turns the blades back into the wind and the brake is released. Soon the blades will spin back to operating speed and the turbine will again produce power.⁶

⁶ “Harvesting the Wind,” Energy and Environment Research Center.
http://www.undeerc.org/wind/literature/wind_brochure.pdf. Viewed May 2, 2005)

Discussion of Capacity Factors

Every place on the map is unique with respect to its capability to generate wind power. When the engineered capabilities of a wind turbine are combined with the wind resource of a particular site, we have the ability to determine capacity factor for annual operation of a wind turbine. The rating of the wind turbine as well as the strength and duration of the wind combine to determine capacity factor. If a 1.65 Megawatt wind turbine produces 5,058,900 kilowatt-hours during the 8760 hours in a year, we can describe this site and turbine pair as having a capacity factor of 35%. $[(5,058,900)/(1650 \times 8760) = 35\%]$ This means that the particular wind turbine produced 35% of its rated output at that site in a particular year. In the analysis to follow, project economics for wind sites ranging from 25% to 50% capacity factor will be analyzed. Each year the site and wind turbine will experience somewhat different patterns of wind strength and duration, so the capacity factor, or the opportunity to convert the wind to electrical power by that particular turbine will also vary.

Operation of Diesel Gensets

Gensets are assembled in factories and transported to suitable locations for operation. Caterpillar offers diesel generators rated from 7 to 16,200 kilowatts and with the reputation of running from 15,000 to 40,000 hours between major overhauls, depending upon the duty cycle. Considering that there are 8760 hours in a year, that's 1.7 to 4.5 years of continuous service. Reports from industry are that some diesel gensets have gone through six or more major overhauls in their lives.⁷ Diesel gensets are rated for output based on three operating conditions, which are standby, prime power, and continuous duty. In the case of an appropriately-sized genset to complement the 1650 kW wind turbine, the output levels are adjusted by changing the revolutions per minute of the engine to produce 2000 kW, 1800 kW, and 1600 kW for standby, prime, and continuous operation, respectively. Gensets in standby operation go from zero to full load in ten seconds with an appropriate cool-down time of ten minutes at the end of their operation. Gensets operated under prime and continuous service receive time to warm-up the engine and gradually ramp-up the generator in advance of full load as well as appropriate cool-down time at the conclusion of their operation.⁸

In a situation such as contemplated in this study, it is necessary to include fuel tanks and a building for the genset and pay for necessary improvements to link a genset site with the power grid. Among the features on a diesel genset are controls to automatically synchronize and parallel the output of the generator with another source. In addition these machines have controls that facilitate smooth transitions of output on and off the utility grid because they are often standby and emergency power units.

⁷ Personal Interview: Paul Meyer, Ziegler Caterpillar, Shakopee, MN

⁸ Ibid.

Overview of the Wind-Genset Workbook

The economic analysis in this project uses an investment model in an electronic workbook that portrays capital costs, revenues, and expenses over the life of a wind turbine of known capacity as well as a diesel genset of the same capacity. Separate spreadsheets were established for the wind turbine and diesel genset. With this technique, relevant conversion factors such as the gallons of #2 Diesel, B55 or B75 biodiesel blends needed to produce particular quantities of kilowatt-hours of electricity over a period of time were determined. In addition, the necessary capital costs and operating expenses are documented for the two methods of generating electricity. A broad range of operating parameters can be tested with this tool in order to understand the sensitivity of resulting electricity costs to various factors such as fuel costs or wind capacity factors for particular sites. As is true of many economic analyses, significant efforts were required to gather supporting budget data for the two methods of generating electricity.

The workbook consists of two spreadsheets that establish specifications and assumptions of operating 1) a wind turbine established on a site and 2) a diesel genset capable of completely replacing the output of that wind turbine. In each case capital costs and operating costs were sought for representative units. The “Genset” sheet also contains summary information from the “Wind” worksheet in order to calculate blended energy costs. The two linked spreadsheets for the two methods of producing power can be readily altered to conform to various assumptions about revenue streams, capital costs and operating expenses over the lives of the investments.

Data Sources

In addition to the review of literature that featured wind complemented by diesel gensets, other studies and data were gathered to complete this economic analysis. Among these studies were several that involved testing of biodiesel blends in diesel generators or gensets, particularly to understand the performance and emissions resulting from use of biodiesel blends. Price histories were reviewed of the cost of petro-diesel fuel as well as the cost of feedstocks that are essential to determining the cost of biodiesel. Without the prevailing federal Biodiesel Tax Credit, biodiesel derived from cheaper feedstocks such as yellow grease and lard can be produced more cheaply than biodiesel derived from vegetable oils, such as soy oil.

Published tariffs for the purchase of electricity from renewable sources were studied to determine appropriate levels of pricing for blended electricity from wind and biodiesel sources. Guidelines contained in PURPA were first developed during the higher energy prices experienced during the Carter Administration and were designed to give renewable sources of electricity access to the electrical power grids. Since that time efforts in Minnesota and other states have refined the definitions of qualifying facilities (QF's) for purposes of offering particular tariffs for power generation. Further refinements and regulatory definitions can be expected in the future.

A key body of wind turbine production data that was analyzed was made available by Minnkota Electric, a power producing cooperative that is owned by and serves several rural electric service cooperatives in Minnesota, North and South Dakota. Minnkota Electric maintains and records the hourly power production of two wind turbines installed several years ago.

Discussion of Wind Data

As a public service Minnkota Power maintains a website with power production data for their Valley City and Petersburg turbines since they have been in operation.⁹ **Figure 8** shows the actual monthly production recorded for two identical 900 kW wind turbines located on two different sites approximately 90 miles apart in North Dakota and operated by Minnkota Power in 2004. **Figure 9** provides further detail regarding the production of power at the two sites, including the monthly capacity factor of each turbine for each month. The availability percentage recorded for each month gives some indication of the amount of time the wind turbines are out of service or in need of repair. When considering annual production, the Valley City and Petersburg sites are remarkably close with 2784 MWh and 2824 MWh produced, respectively. Although each turbine had higher production than its twin in certain months, their annual capacity factors were 35.3% and 35.8% for Valley City and Petersburg, respectively in 2004. Evident in the graph are the lower levels of power production from wind in June, July, August, and September. This pattern can be particularly troubling for utilities because the summer months are firmly established as the times of peak power demand in most areas of the U.S. In addition, peak production of power exceeded nameplate during winter months

⁹Minnkota Power, 2004 Statistics. Website: <http://www.minnkota.com/Pages/InfinityMonthly.htm>, viewed August 1, 2005

with colder, denser air and higher winds. The highest monthly capacity factor of 49% was recorded in November, 2004 at Petersburg, ND. The same turbine experienced some mechanical issues in August and December when it had availability of 87%. **Figure 9** also contains evidence that wind turbines can produce power above their recorded nameplates with peaks above the 900 kilowatt nameplate recorded in the months of December-March each year.

Figure 8.

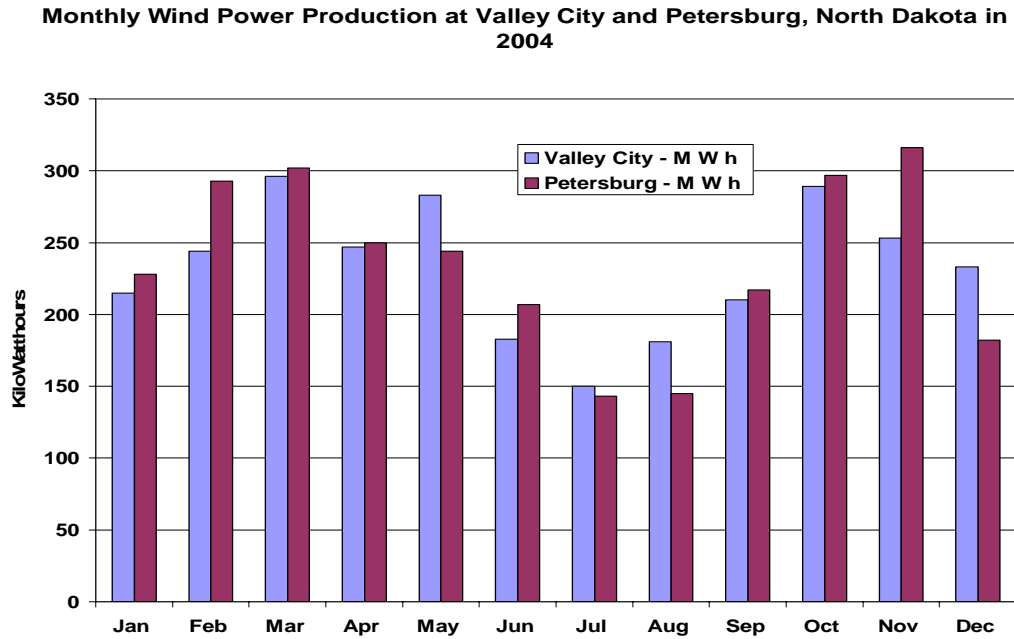


Figure 9.

2004 Monthly Statistics *Infinity* - Valley City, ND
900 kW Wind Turbine

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Power production - MWh	215	244	296	247	283	183	150	181	210	289	253	233	2784
Average wind speed - mph	16	17	19	17	18	15	13	14	16	19	18	17	
Capacity factor - %	32	39	44	38	42	27	22	27	32	43	39	35	
Peak output - kW	937	939	973	866	881	757	721	785	786	900	866	929	
Availability - %	91	98	99	99	99	99	99	93	100	100	90	99	

2004 Monthly Statistics *Infinity* - Petersburg, ND
900 kW Wind Turbine

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Power production - MWh	228	293	302	250	244	207	143	145	217	297	316	182	2824
Average wind speed - mph	16	19	20	17	18	16	13	14	16	19	20	18	
Capacity factor - %	34	47	45	39	36	31	21	22	33	44	49	27	
Peak output - kW	934	904	940	838	815	752	674	754	757	844	845	928	
Availability - %	95	99	99	99	99	97	97	87	100	100	100	87	

Analysis of Hourly Wind Production Data

Minnkota also offers hourly production data for its two wind turbines.¹⁰ This body of data offers greater opportunity to understand the requirements to complement wind power, especially for the hours of the day when utilities need to be “on-peak” during the key months of June, July, August, and September. **Figures 10, 11, 12, and 13** are graphs that show the hour by hour production of power during On-Peak hours by Minnkota Electric’s Petersburg, North Dakota wind turbine in the months of June-September of 2003, the key time periods when capacity payments are made for qualifying facilities that achieve 65% capacity during the hours 9:00 a.m. to 9:00 p.m., Monday through Friday, excluding holidays. The four graphs reveal the effect of lower wind velocities during that time of the year, particularly in July.

¹⁰ Minnkota Power, Hourly Historical Output. Website:
<http://www2.minnkota.com/%7Elmbbs/infinityoutput.xls>

Figure 10. June 2003 Hourly On-Peak Power Production from Wind at Petersburg, ND (Source: Minnkota Electric)

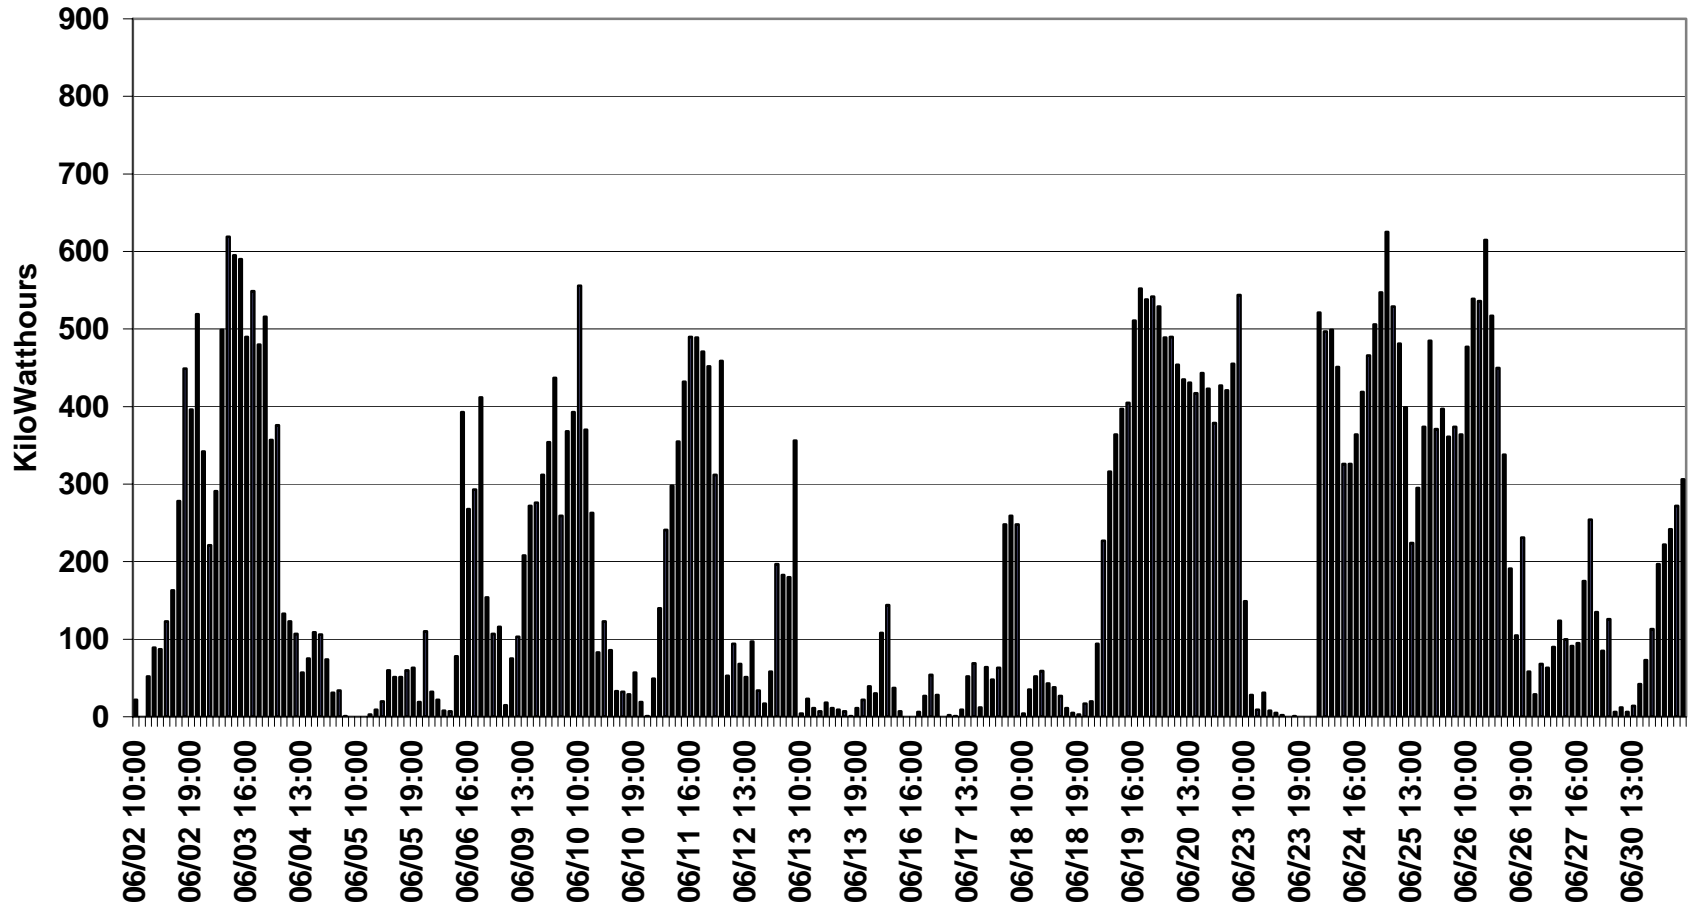


Figure 11. July 2003 Hourly On-Peak Power Production from Wind at Petersburg, ND (Source: Minnkota Electric)

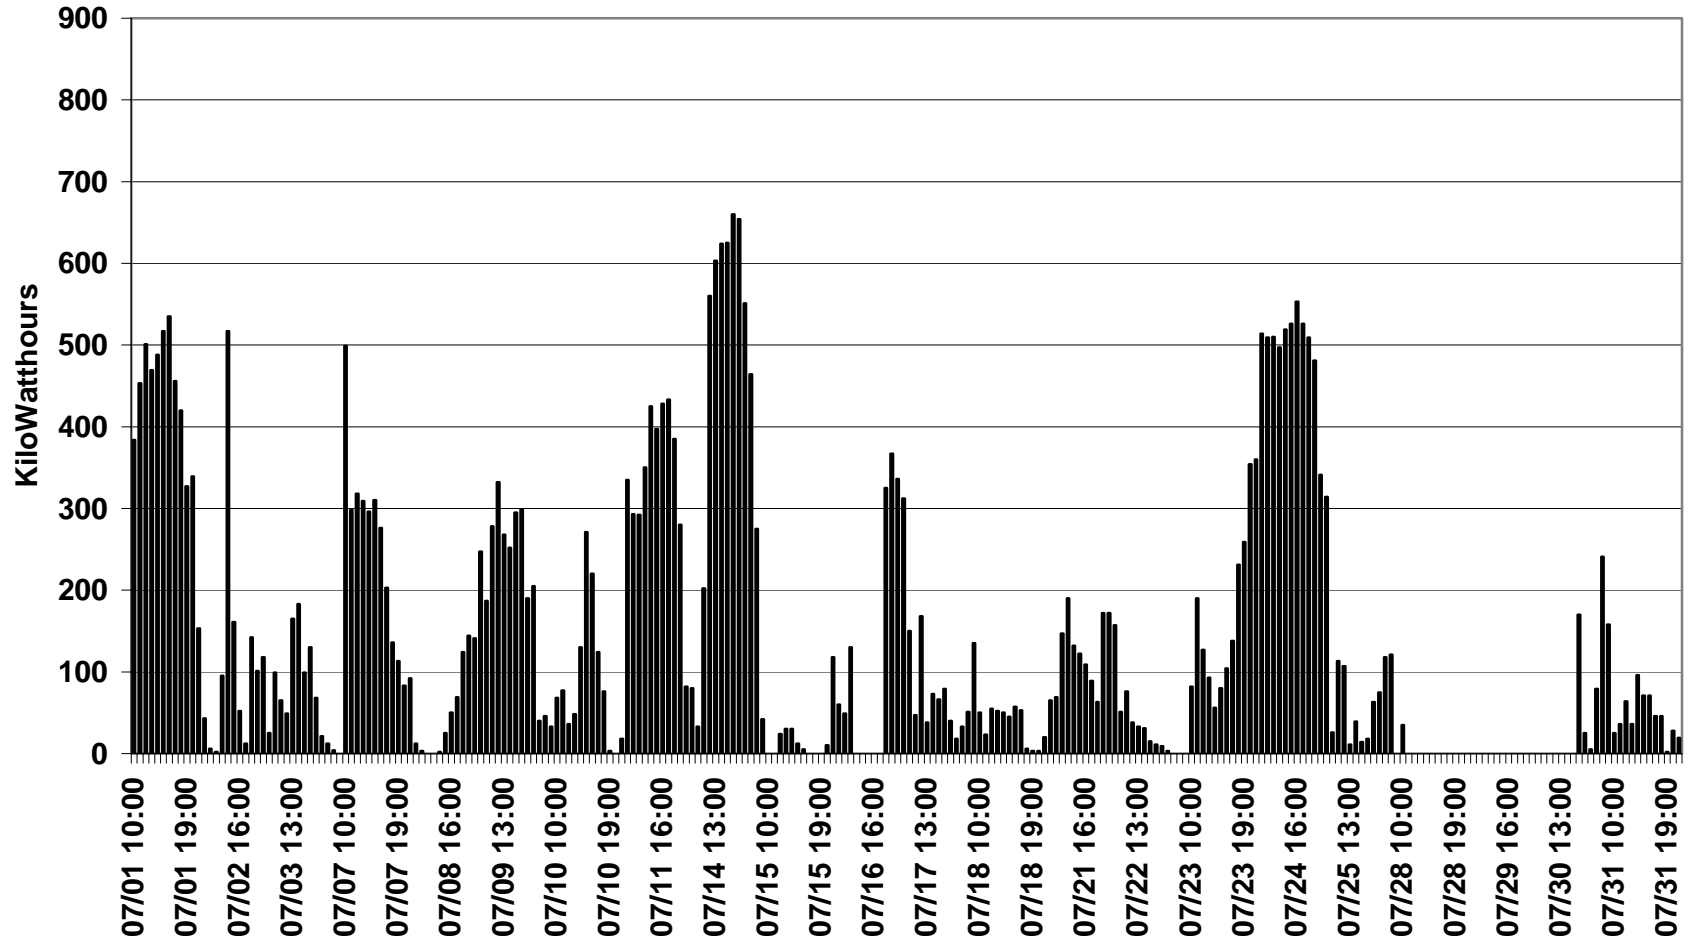


Figure 12. August 2003 Hourly On-Peak Power Production from Wind at Petersburg, ND (Source: Minnkota Electric)


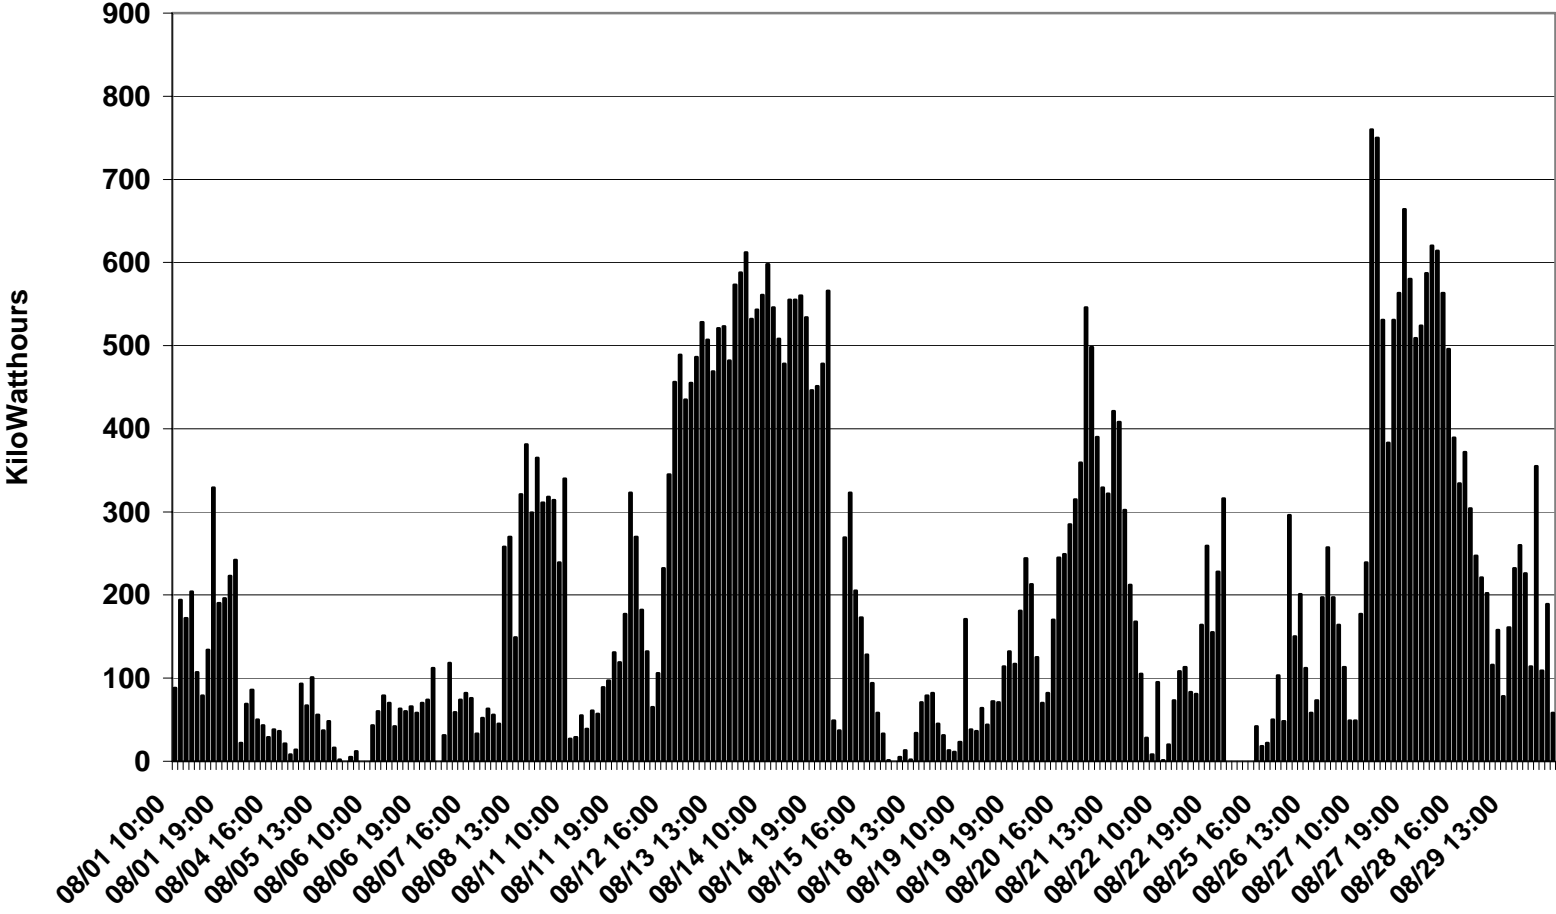


Figure 13. September 2003 Hourly On-Peak Power Production from Wind at Petersburg, ND (Source: Minnkota Electric)

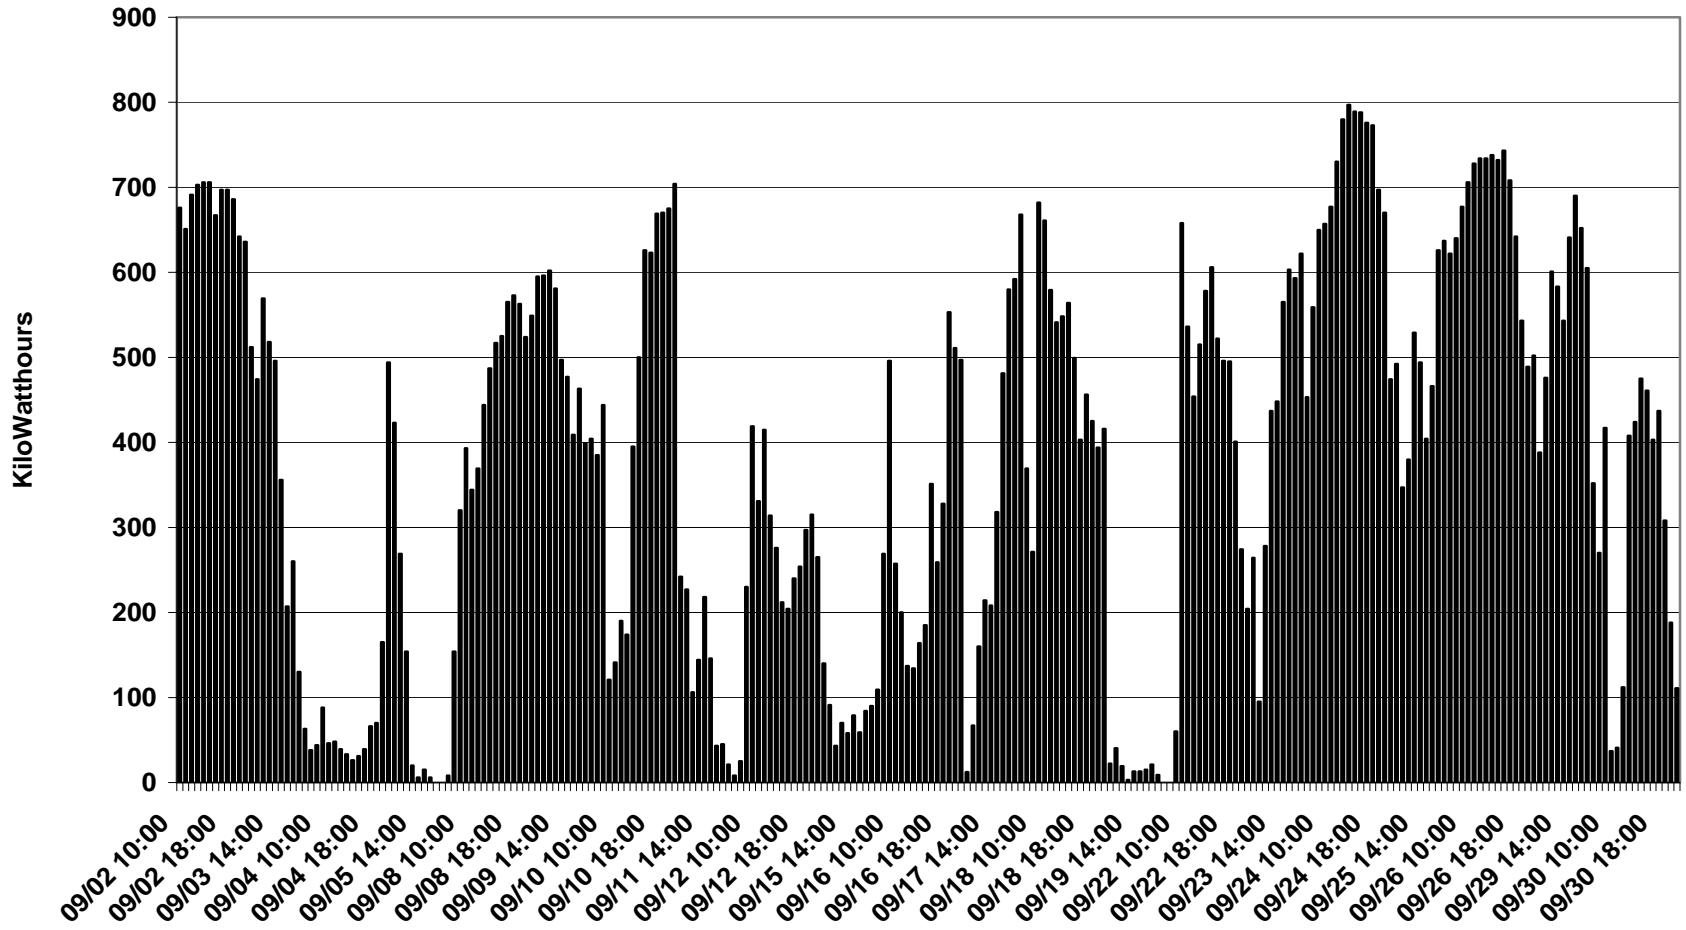

Measurement of On-Peak Gaps

Once one gains an understanding of the pattern of hourly power production by the wind turbines over each of the key months June-September, it is important to look at the production of wind during the on-peak hours of 9:00 am through 9:00 pm Monday through Friday except during the key holidays of July 4 (or the Monday following it, if it falls on a weekend) and Labor Day (1st Monday in September). The historical hourly wind data was sorted to cut out the non-peak hours of each of the four key months. Then actual wind power production was subtracted from 65% of wind nameplate capacity to determine the “on-peak gaps” in power production from wind. **Figure 14** contains the number of hours that wind would need to be complemented by a genset at rated output based on the wind production at Valley City and Petersburg during 2003 and 2004 during the peak hours 9:00 a.m. to 9:00 p.m. during working days during the summer months.

Figure 14.

Hours of Genset Operation at Nameplate Needed to Reach Combined 65% Capacity with Wind Turbine for On-Peak Hours of June-Sept. at Valley City and Petersburg, ND

	June	July	Aug	Sept.	Totals per Site and Year
Valley City 2003	107.57	122.28	107.64	69.44	406.93
Valley City 2004	84.34	138.84	111.55	96.81	431.54
Petersburg 2003	106.8	129.11	106.4	57.28	399.59
Petersburg 2004	79.45	140.78	113.39	91.29	424.91
Mean Hours	94.54	132.75	109.75	78.71	415.74

What becomes clear is the number of hours that a diesel genset would have to run in each of the four key months during on-peak hours in order to achieve a combined capacity factor of 65% with the wind turbine. Looking at the years of 2003 and 2004 at the two locations, June, July, August, and September would have required the following number of genset hours of operation at its nameplate capacity: June---94.54, July---132.75, August---109.75, and September---78.71 . Mean total hours of genset operation for the two sites over the two years of the data would have been 416 hours. This figure will be important in analyzing the economics of using diesel gensets to complement wind turbines during the on-peak hours of June-September at Minnesota wind sites with similar capacity factors.

Capital Costs of Wind Turbines

Establishment of a wind turbine must be preceded by an adequate wind survey of a potential site. Towers are set up with anemometers in order to monitor the wind over a year's time. Wind velocity readings are often taken at 70 meters this height because at these heights wind turbines suffer less turbulence from trees, buildings, ground surface roughness, or local relief. When a site with suitable wind resource is identified, wind development easements are typically executed so that the contracting party can proceed to development if other considerations are satisfied. Chief among these is the location of the possible site for interconnection with the grid. There are typically capital costs for securing a service road to the tower and the area occupied by the tower supporting the turbine. Further capital costs include the installation of electrical cable to transmit the power produced by the turbine. When wind farms containing numerous wind turbines are established in an area, a control center is usually established that electronically monitors the production of power from many turbines. A shop area containing tools for turbine maintenance is generally part of the control center. The typical life of a wind turbine may vary based on the climate where established. However, increasing experience seems to indicate that 20 years of life is reasonable for many of the modern turbines being erected today. Some contacts have suggested that turbine blades or the generator, itself may be replaced by superior models after twenty years of operation.

Operating Costs of Wind Turbines

As mentioned previously, wind power requires large up-front investments. Because no fuel must be purchased operating expenses are typically quite small. However, wind turbines, like many machines have bearings and fittings that require routine greasing and inspection. In some situations, it is necessary to clean impacted insects from the turbine blades to maintain high efficiency. There are instances when damage can occur from ice, high winds, or lightning that may require substantial repairs by trained mechanics. Wind turbines occasionally suffer fires and various protection components may need to be replaced. Most wind turbines have instrumentation to report levels of production. Many wind turbines are sold with maintenance packages and insurance for damage from various problems that might render the turbine inoperable. Particularly important to lenders are insurance policies that protect against business interruptions. In some cases the international firms selling the wind turbines must gain an appreciation for the unique hazards of high winds, ice, and lightning in a particular locality. Electricity to run instrumentation on a wind turbine and annual lease payments for site of the wind turbine are additional operating expenses.

Discussion of Diesel Gensets

Gensets are engine-driven generators of various sizes, which are typically diesel powered in the case of larger units. The engine converts the chemical energy of a fuel into mechanical energy that spins coils of wire around magnets in order to produce electricity that is typically A.C. and at a particular kilowatt rating. Substantial losses in energy occur from the conversion of chemical energy in the fuel to mechanical energy at the shaft turning the generator to the conversion of electrical energy as it leaves the generator. Review of performance data on diesel gensets reveals they are capable of converting the lower heating value (LHV) of diesel fuel to work energy at a 41.27% rate. Then the conversion of mechanical energy delivered to the generator to electrical energy output is typically 93.90% efficient.¹¹ So from diesel fuel to electrical current, 38.75% of the energy is available after conversion, or 68.38 gallons of diesel fuel per Megawatt-hour in modern gensets. Presumably this loss in energy is acceptable because the chemical energy in the fuel is being changed to a more useful form—electrical current. Gensets are used widely to provide back-up and emergency electricity in many settings. In many cases gensets are restricted to providing electricity only for specific buildings, appliances, and equipment. In other instances electrical power from gensets may be permitted to flow beyond immediate locations and contribute to power available on the electrical transmission grid. For purposes of this study, we shall confine our analysis to a genset capable of replacing some or all of the power from an idle wind turbine rated at 1.65 MW. Further study may determine the opportunity of complementing the production of multiple wind turbines with large generators, whether diesel gensets or powered by natural gas or another fuel.

Like other diesel-powered equipment, gensets experience longer lives when given adequate time to warm up and cool down before and after operation. Gensets consume little fuel when idled for extended periods, producing no power. They are then available to quickly respond to load requests.

Capital Costs of Diesel Gensets

The diesel genset and switchgear considered of appropriate size to complement a 1.65 MW wind turbine would cost \$350,000, or \$175.00 per kilowatt of standby capacity.¹² To protect the genset and its fuel storage tank from the elements and keep the system ready for quick starts, a building is assumed a necessary expenditure

Operating Costs of Diesel Gensets

Diesel gensets, like most diesel engines, require certain routine maintenance activities such as changes of motor oil, filters, coolants and servicing of fuel injectors. These are relatively minor, but important expenditures for an engine that may operate for long periods of time at constant loads. Many diesel gensets remain operational for decades with typical maintenance schedules. The chief operating expense is that of fuel. Estimates of fuel requirements per kilowatt-hour produced are considered relatively uniform for many gensets available today.

¹¹ Caterpillar, Inc. Gen Set Package Performance Data for Sales Model 3516BDITA, dated December 3, 2004.

¹² Paul Meyer, Ziegler Caterpillar, Shakopee, MN.

Assumptions

Electrical Revenue, Rules and Tariffs

The Minnesota Electric Rate Book –MPUC No. 2, contains a section entitled “Technical and Special Terms for Cogeneration and Small Power Production,” that identifies a number of rules and definitions needed to determine revenue for wind turbines complemented by generators using renewable fuels. Here are two key regulatory definitions:

- Firm Power** Firm power is energy delivered by a QF to the utility with at least 65% on peak capacity factor in the billing period. The capacity factor is based upon a QF’s maximum on-peak metered capacity delivered to the utility during the billing period.
- On-Peak Period** The on-peak period contains all hours between 9:00 am and 9:00 p.m. Monday through Friday, except the following
Independence Day, Labor Day, Thanksgiving Day, and Christmas Day. When a designated holiday occurs on Sunday, the following Monday will be designated a holiday.

In 2003, capacity payments of \$.01 per kWh for Firm Power were offered for on-peak power during the key June-September period by Northern States Power Company (NSP) in Minnesota.¹³ Currently the published rates per kilowatt hour and for capacity are \$.0620 and \$.0367, respectively.¹⁴ It must be emphasized that this tariff represents an annual offering, so it would be difficult for a power producer to project earnings at this level for the life of the investment. No qualifying facility (QF) can hope to sell power and receive capacity payments from Xcel Energy (NSP’s successor organization) for more than a year at these rates. In fact, discussion with an Xcel employee¹⁵ revealed that no QF’s were currently receiving such a package of payments.

¹³Northern States Power Company, Minnesota Electric Rate Book-MPUC No.2, Section 9, 5th Revised Sheet No. 3, filed 12/31/02 by Ken T. Larson., with an effective date of 1/01/03.

¹⁴ Xcel Energy Tariff Document, Time of Day Purchase Service, Section No. 9, Rate Code A52 , 7th Revised Sheet No. 4, filed on January 3, 2005.

¹⁵ John Chow, Xcel Energy, phone conversation, August 4, 2005.

Biodiesel Blend Levels in Cogeneration under PURPA

According to PURPA regulations, definitions for renewable energy include the following two standards:

- 1) Primary fuel (without cogeneration)¹⁶ means a minimum of 75% of the total energy input in any calendar year if cogeneration is not used at the facility.
- 2) Primary fuel (with cogeneration)¹⁷ means a minimum of 55% of the total energy input in any calendar year if cogeneration is used at the facility.

These standards suggest that electricity derived from biodiesel blends of 75% (B75) in a cogeneration setting shall be accepted as a Qualified Facility (QF). In the event that heat is captured and used by the QF, 55% biodiesel blends (B55) would qualify.

We assume typical operations of diesel gensets to complement wind turbines will be remote from other processing facilities and unable to utilize energy from cogeneration. Because B75 blends are assumed necessary to qualify under PURPA, B75 blends were studied in the analysis section of this paper.

Costs of Diesel and Biodiesel

Data from the Energy Information Agency were used to construct **Figure 15**, which shows Minnesota wholesale prices for No. 2 Diesel fuel for January 1999 through April 2005. This price is comparable to the price that would be paid for bulk delivery of diesel. As this paper is written, historically high prices for crude oil have pushed all petroleum products to record levels in nominal terms, with No. 2 Diesel priced at \$1.80 per gallon. Prices for diesel fuel are determined by worldwide markets and are influenced by production levels of crude oil, refinery capacity, and seasonal demand for such uses as fuel oil for home heating. Within the U.S., diesel and petroleum are generally transported quite inexpensively by pipelines to regional distribution centers.

¹⁶ Public Utilities Regulatory Policies Act, Code of Federal Regulations, 18CFR292.204 (b) (1) (i).

¹⁷ Public Utilities Regulatory Policies Act, Code of Federal Regulations, 18CFR292.205 (a)(2)(i)(B).

Figure 15.

Price of No. 2 Diesel Fuel in Minnesota Excluding Tax, Jan 99- Apr05

Source: Energy Information Agency




Costs to produce biodiesel depend largely upon the price of the oil feedstock used to make it, whether from virgin vegetable, recycled vegetable, or animal sources. However, the market clearing prices for biodiesel depend upon its value as a substitute for petrodiesel and its value as a fuel additive to improve lubricity in ultra-low-sulfur-diesel and reduce emissions including particulates. In Minnesota, a 2% mandated blend level of biodiesel will be effective in restoring lubricity of diesel fuel when EPA regulations require Ultra-Low Sulfur Diesel (ULSD) in 2006 in advance of new diesel engines appearing in 2007.

Firms choosing to produce biodiesel generally design and locate their facilities to utilize de-gummed soybean oil even though soybean oil is typically much more expensive than other sources of fats, particularly recycled yellow grease, which is often half the cost. This is evident with the establishment of production facilities at Brewster and Glenville, Minnesota in 2005 as well as a plant planned for Iowa Falls, Iowa in 2006. The behavior of the biodiesel firms demonstrates their preference for using soybean oil despite its higher price and their confidence that the Biodiesel Tax Credit of \$1.00 per gallon of agricultural biodiesel will remain in force for some time. Lacking the Biodiesel Tax Credit, one would expect the production of biodiesel to predominate in close proximity to population centers with large supplies of waste grease or in locations near slaughter facilities with large supplies of tallow and lard.

A detailed study of biodiesel production costs by Haas, McAloon, Yee, and Foglia reported the cost of biodiesel at \$2.00 per gallon using soybean oil priced at \$.236 per pound and revealed that 88% of total estimated production costs are due to the cost of the oil feedstock.¹⁸ Based on Haas et al. and their study, costs of biodiesel derived from soybean oil conform to **Figure 16**.

Figure 16.

Biodiesel Costs Based on Soybean Oil Costs with Credit for Glycerol

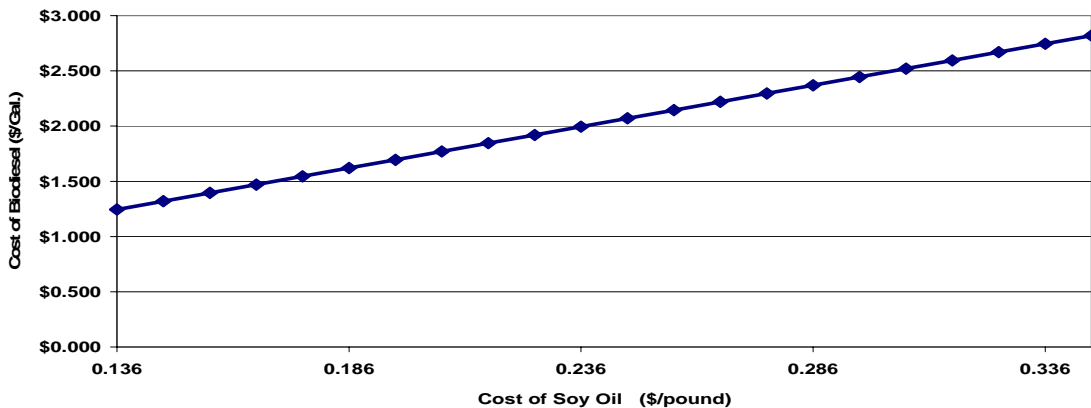

(Source: Haas, et al., Bioresource Technology, Elsevier)

¹⁸ Haas, Michael J., et al. "A Process Model to Estimate Biodiesel Production Costs," Bioresource Technology, accepted paper, pending publication.

Biodiesel production in the U.S. is small at 30 million gallons per year in 2005, but is currently experiencing rapid expansion in capacity.¹⁹ The nations of the European Union produced over 450 million gallons in 2003 with heaviest reliance on the feedstock of rapeseed oil, derived from rapeseed grown on set-aside acres.²⁰

Anthony Radich performed a detailed study of biodiesel for the Energy Information Agency and predicted the costs biodiesel made from soybean oil or yellow grease and with or without the proposed Biodiesel Tax Credit. Fate and circumstances made his projections of the cost of petro-diesel far lower than experienced in 2005. However, his projections for costs of biodiesel are sound and found in **Figure 17**.²¹

Figure 17.

Projected Production Costs for Diesel Fuel
by Feedstock, 2004-2013 (2002 Dollars per Gallon)

Marketing Year	Soybean Oil	Yellow Grease	Petroleum	Soybean Oil with Credit	Yellow Grease with Credit
2004/05	2.54	1.41	0.67	1.54	0.91
2005/06	2.49	1.39	0.78	1.49	0.89
2006/07	2.47	1.38	0.77	1.47	0.88
2007/08	2.44	1.37	0.78	1.44	0.87
2008/09	2.52	1.40	0.78	1.52	0.90
2009/10	2.57	1.42	0.75	1.57	0.92
2010/11	2.67	1.47	0.76	1.67	0.97
2011/12	2.73	1.51	0.76	1.73	1.01
2012/13	2.80	1.55	0.75	1.80	1.05
Means	2.58	1.43	0.76	1.58	0.93

Yellow grease is usually predicted to be 49% of the cost of soybean oil and soybean oil was predicted based on Energy Information Agency (EIA) models. The transportation bill passed by the U.S. Congress includes excise tax credits for biodiesel blending that can be claimed against Federal motor fuels excise taxes. If the biodiesel is made from virgin oil, the credit is \$1.00 per gallon. If the biodiesel is made from non-virgin oil such as yellow grease, the credit is \$.50 per gallon of biodiesel used in a blend. Alternatively, business tax income tax credits at the same rates are offered for virgin and non-virgin oil for users not using transportation fuels. The federal tax credits on biodiesel will be available through 2008.

¹⁹ McCoy, M., 2005. "An Unlikely Impact," Chemical Engineering News 83 (8) p. 19

²⁰ European Biodiesel Board, 2004, "Biodiesel Production Statistics," website: <http://www.ebb.eu.org/stats.php>.

²¹ Radich, Anthony. Energy Information Agency. Website: <http://tonto.eia.doe.gov/FTP/ROOT/environment/biodiesel.pdf> - Aug. 2, 2005

Analysis

Calculations using the workbook were carried out by setting assumptions on the “Wind” and “Genset” spreadsheets with examples following in **Figures 18 and 19**.

Discount rates, percentages financed, and interest rates established on the “Wind” spreadsheet are also applied in the “Genset” spreadsheet. The two linked spreadsheets for the two methods of producing power can be altered to conform to various operating expenses and capital costs.

The “Wind” spreadsheet in **Figure 18** establishes the power production by a particular model of wind turbine operating on a site with a specified capacity factor. Under “Assumptions,” cells shaded yellow in the spreadsheet allow one to specify wind turbine capacity, capacity factor, and price for purchased power, discount factor for the investment and the salvage value or even additional removal expense at the end of the assumed twenty year life. Additional assumptions should be established for the percent equity and debt as well as the rate of interest charged on debt. Amounts for up-front capital are entered under “Capital Expenditures” and include site investigation costs, legal fees covering sites, easements, and power purchase agreements. Working capital is also included as well as the costs of the very tangible wind turbine and feeder lines.

Under the Revenues or Credits section of the spreadsheet, Revenues for the sale of electricity are listed in each of the twenty years in Row 23. The potential credits available from the federal Production Tax Credit (PTC), which is currently 1.9 cents per kilowatt-hour produced are listed for the first ten years in Row 24. The PTC would have no value if the owner or owners have insufficient tax liability to use the credit on passive income. **Figure 18** also shows the Minnesota Small Producer Wind Incentive payment for each of the first ten years of operation at the rate of 1.5 cents per kilowatt hour produced. Although no value is listed, another potential source of income for the owners of a wind turbine are the sale of “green tags,” which may have value if sold to businesses or utilities that need them in particular states. In many instances green tags are transferred to the utility buying the power in the course of negotiating the power purchase agreement (PPA). Many rural businesses and cooperatives can receive U.S. Department of Agriculture grants up to 25% of non-land capital costs in advance of production starting, also noted with a yellow-shaded cell **C27**.

Wind operating expenses are listed for each year of the estimated twenty years of operation and include the annual amounts for land lease, service and warranty packages, electricity, insurance, accounting, and local real estate taxes based on production of electricity. These amounts are listed in rows 31 -36 for years 1-20. Debt service consisting of equal amortized principal and interest payments are recorded for the first ten years in **Row 37**.

After Net Operating Expenses are calculated for each of the twenty years in the projected life of the wind turbine, the Net Cash Flow for each year is calculated and recorded in **Row 40**. **Row 41** records the discounted cash flow of each year using the 9.0% rate establish is cell **C8**, while **Row 42** records the accumulated discounted cash flow with

each passing year of the wind turbine project. In year 20, \$161,300 is assumed to be received as a salvage value of the wind turbine. The Net Present Value of the Project is shown in cells **C44** and also **M4**. Cell **M5** contains the average cost per kilowatt-hour produced over the 20 years. Cell **M6** contains the internal rate of return that was achieved by the cash flows actually received and is 9.47% in **Figure 18** with the wind site having a 35% capacity factor.

The “Genset” worksheet (**Figure 19**) establishes the capital cost to purchase and site a typical diesel genset. The format of this spreadsheet is very similar to the one established for the wind turbine. However, the genset worksheet has some other cells to record assumptions for fuel cost, hours of operation, and the blend percentage of biodiesel utilized. Cell **C5** contains the annual percentage of time that the genset would run and results in the hours recorded in cell **C6**. Cell **C7** records the annual production based on the hours of operation and the genset’s rated capacity (**C4**). Cells **H5-H7** establish the amount of interest and principal to be repaid. Cells **H9** and **H10** establish the effective prices for diesel and biodiesel, respectively. Cell **H11** establishes the biodiesel blend level to be utilized and become a Qualified Facility (QF).

There are budgeted capital costs for the genset, a building to house it, the tanks for fuel, interconnection equipment, and transmission lines in cells **C15-C19**.²² Capital amounts required for site negotiation and easement legal fees were based in part on estimates made for wind turbines. Of note is the salvage value established for the genset in cell **C11**.

In terms of revenue and credits, the diesel genset is assumed to receive \$.0620 during June through September for each kWh produced as well as \$.0367 as a capacity payment for each of the On-Peak Hours that the genset is available to operate in the June-September period. These figures are recorded in **C8** and **C9**, respectively. The assumption is made that the genset is operated only during the summer months and that all the capacity payments should be allocated to the genset even though the genset is responsible for only part of the power output. This is based on the published documents filed by Northern States Power (NSP) with the Minnesota Public Utilities Commission.²³ The revenue from the sale of “green tags” which are sometimes sold at \$.01 per kWh is ignored in our analysis because a utility such as NSP may acquire these in the course of granting a power purchase agreement (PPA). The genset spreadsheet in cell **C29** also portrays the situation of numerous rural organizations such as coops and limited liability corporations eligible to receive USDA Economic Development grants, which have the effect of reducing the amount of initial capital required.

²² Interview: Paul Meyer, Ziegler Caterpillar.

²³ Xcel Energy Tariff Document, Time of Day Purchase Service, Section No. 9, Rate Code A52 , 7th Revised Sheet No. 4, filed on January 3, 2005.

Annual fees for a maintenance plan for the genset are recorded in **Row 33**. Debt service is shown in the first ten years based on equal amortized annual payments in **Row 34**. Insurance premiums of \$2,000 per year were budgeted for each of the twenty years of the genset's life in **Row 35**. Fuel cost (**Row 36**) reflects the blend level selected, the prices of the petro-diesel and biodiesel, as well as the requirement of 5.5% more biodiesel to satisfy the same amount of power output by the genset.^{24 25} Property taxes of \$675 per year were estimated and recorded in **Row 37** for the building and the small lot it would occupy. After "Revenues and Credits" are reduced by "Operating Expenses and Capital Expenditures," "Net Cash" flows are determined for each of the twenty years of the genset's life. Then the net cash flows are discounted by the established rate 9.0% (**C10**).

The Net Present Value for the genset project is recorded in cells **C43** and **M4**. Among the other conclusions are those for the "Genset Alone" in column **M**, with average cost per kWh in **M5** and the internal rate of return for the genset in **M6**. **M8** has the annual production in kilowatt-hours of the genset with the gallons of two types of diesel and in total in cells **M9-M11**.

Conclusions in **Column N** offer a review of the conclusions from the wind spreadsheet in cells **N5, N6, N7, and N8**. In **Column O** we have conclusions for the hybrid operation of the wind turbine and the diesel genset. **Cell O4** contains the overall NPV of the combined project, while **O5** contains the average cost per kilowatt-hour for the combination of wind turbine and genset operation. **Cell O6** contains the combined internal rate of return for both machines producing electrical power, while **O8** contains the amount of electricity produced by the pair.

²⁴ Determination of fuel requirement for various biodiesel blends was based on the following data: diesel fuel has a LHV of 129,050 BTU per gallon; biodiesel has a LHV of 118,170 BTU per gallon. Biodiesel has a higher density per unit of volume with 7.328 pounds per gallon versus 7.079 pounds per gallon in diesel. Based on these two relationships, it is reasonable to calculate that 5.50% greater volume of biodiesel will be needed to produce the same amount of power as petro-diesel.

²⁵ "2004 Biodiesel Handling and Use Guidelines." U.S. Department of Energy, Energy Efficiency and Renewable Energy Division. Website: <http://www.osti.gov/bridge>.

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W		
1	Figure 18.	Wind Turbine Production Economics										by Douglas G. Tiffany, Dept. of Applied Econ., University of Minnesota 8/3/2005													
2																									
3		Assumptions:										Conclusions:													
4	Wind Turbine Capacity		1,650	MW		Percent Equity		40.00%																	
5	Capacity Factor of Wind Site		35	%		Percent Debt		60.00%																	
6	Annual Production		5,058,900	KWH		Interest Rate		7.00%																	
7	Price for Purchased Power		\$0.0330	per KWH																					
8	Discount Factor (%)		9.00%																						
9	Salvage Value(+)/Removal Cost (-)		\$161,300																						
10		1,0	Initial	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
11	Capital Expenditures																								
12	Site Investigation		20,000																						
13	Legal-- for Site		2,000																						
14	Legal-- Power Purchase		5,000																						
15	Interconnection Fees		5,000																						
16	Tower, Turbine & Installation		1,613,000																						
17	Transmission Feeder Lines		2,000																						
18	Working Capital		8,000																						
19	Salvage Value/Removal Expense																						-161,300		
20	Total Capital Expenditures		1,655,000																				-161,300		
21																									
22	Revenue or Credits																								
23	Power Purchased	1	0	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	
24	Production Tax Credit (Federal)	1	0	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	96,119	
25	MN Sm Producer Paymt (@ 1.5	1	0	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	75,884	
26	Sale of Green Tags @ \$.01/ kWh	0																							
27	USDA Rural Develop. Grant	1	300,000																						
28	Total Revenue or Credits		300,000	338,946	338,946	338,946	338,946	338,946	338,946	338,946	338,946	338,946	338,946	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	166,944	
29																									
30	Operating Expenses																								
31	Land Lease			4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	4,000	
32	Service and Warranty			12,500	12,500	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900	23,900
33	Electricity			1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000
34	Insurance			10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000	10,000
35	Accounting			1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000	1,000
36	Property Taxes (production)			607	607	607	607	607	607	607	607	607	607	607	607	607	607	607	607	607	607	607	607	607	607
37	Debt Service (P+ I)			141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	141,381	
38	Total Operating Expenses		0	170,488	170,488	181,888	181,888	181,888	181,888	181,888	181,888	181,888	181,888	181,888	181,888	181,888	40,507	40,507	40,507	40,507	40,507	40,507	40,507	40,507	40,507
39																									
40	Net Cash Flow		-1,355,000	168,458	168,458	157,058	157,058	157,058	157,058	157,058	157,058	157,058	157,058	126,437	126,437	126,437	126,437	126,437	126,437	126,437	126,437	126,437	126,437	126,437	287,737
41	Disc. Cash Flow of Year		-1,355,000	154,549	141,788	121,278	111,264	102,077	93,649	85,916	78,822	72,314	66,343	48,998	44,953	41,241	37,836	34,712	31,846	29,216	26,804	24,591	22,511	20,561	51,341
42	Cumulative Disc. Cash Flows			154,549	296,337	417,615	528,879	630,956	724,605	810,521	889,344	961,658	1,028,001	1,076,999	1,121,952	1,163,193	1,201,028	1,235,740	1,267,586	1,296,802	1,323,605	1,348,196	1,369,537	1,387,000	1,399,537
43			Initial	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
44	Net Present Value of Project		44,537																						
45																									

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W	X
1 Figure 19.		Diesel Genset Production Economics										by Douglas G. Tiffany, Dept. of Applied Economics, University of Minnesota 8/3/2005												
2		Assumptions:										Conclusions:												
3		Diesel Genset Capacity 1.650 MW Capacity Factor for Genset 4.75% Hours of Annual Operation 416.1 Hours Annual Production 686,565 KWH Price for Purchased Power \$0.0620 per KWH Price for Power Capacity \$0.0367 per KWH Discount Factor 0.09 Salvage Value(+)/Removal Cost (-) \$45,000										Percent Equity 40.00% Percent Debt 60.00% Interest Rate 7.00% Price of Diesel \$1.80 Price of Biodiesel \$1.80 Blend 75												
4												Genset Alone Wind Alone Wind & Genset NPV of 20 Yr. Project 11,977 44,537 56,514 Average Cost per KWH \$0.14450 \$0.03652 \$0.04942 IRR for Project 9.32% 9.47% 9.43% Annual Production (kWh) 686,565 5,058,900 5,745,465 Petro-Diesel Gallons 11,850 Biodiesel Gallons (B100) 35,548 Total Gallons of Fuel 47,399												
14 Capital Expenditures		Initial	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
15 Interconnection Fees		5,000																						
16 Site & Service Road Acquisition		5,000																						
17 Tanks and Building		100,000																						
18 Diesel Genset with swithgear		350,000																						
19 Transmission Feeder Lines		25,000																						
20 Salvage Value(+)/Removal Cost(-)																								-45,000
21 Total Capital Expenditures		485,000																						-45,000
22																								
23 Revenue or Credits																								
24 Power Purchased	1	0	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567	42,567
25 Power Capacity Payment	1	0	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401	88,401
26 Production Tax Credit (Federal)	0	0																						
27 Small Wind Producer Payment (MN)	0	0																						
28 Sale of Green-Tags @ .01/kWh	1	0																						
29 USDA Rural Develop. Grant	1	75,000																						
30 Total Revenue or Credits		75,000	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968	130,968
31																								
32 Operating Expenses																								
33 Maintenance Plan		0	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095	7,095
34 Debt Service (P+I)			41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432	41,432
35 Insurance		0	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000	2,000
36 Fuel Cost		0	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399	47,399
37 Property Taxes			675	675	675	675	675	675	675	675	675	675	675	675	675	675	675	675	675	675	675	675	675	675
38 Total Operating Expenses		0	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926	97,926
39																								
40 Net Cash Flow		-410,000	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	74,474	74,474	74,474	74,474	74,474	74,474	74,474	74,474	74,474	119,474
41 Disc. Cash Flow of Year		-410,000	30,314	27,811	25,515	23,408	21,475	19,702	18,075	16,583	15,214	13,958	12,861	12,647	24,292	22,286	20,446	18,758	17,209	15,788	14,485	13,118	11,818	21,318
42		Initial	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
43 Net Present Value of Project		11,977																						
44																								
45 Net Cash Flow Genset		-410,000	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	33,043	74,474	74,474	74,474	74,474	74,474	74,474	74,474	74,474	74,474	119,474
46 Net Cash Flow Wind		-1,355,000	168,458	168,458	157,058	157,058	157,058	157,058	157,058	157,058	157,058	157,058	157,058	157,058	126,437	126,437	126,437	126,437	126,437	126,437	126,437	126,437	126,437	287,737
47 Combined Net Cash Flow		-1,765,000	201,501	201,501	190,101	190,101	190,101	190,101	190,101	190,101	190,101	190,101	190,101	190,101	200,911	200,911	200,911	200,911	200,911	200,911	200,911	200,911	200,911	407,211

Results of Analysis

Production Economics of Wind Turbines Alone

The first stage of analysis was to use the spreadsheet model to analyze the economic performance of wind turbines alone. In this regard, the effects of various capacity factors were determined on the production and project financial performance, as seen in **Figure 20**. As the capacity factors go up along with the kilowatt-hours produced per year, the costs per kilowatt-hour go down. When capacity factor goes from 25% to 50%, the cost per kilowatt-hour is essentially cut in half. At higher capacity factors net present values for wind turbine projects rise as do their internal rates of return. At capacity factors of 25% and 30% the NPV's are negative, meaning that it would be unwise to develop such a project when considering a 9.0% discount rate along with the other assumptions established. When the capacity factor rises to 35%, the NPV is positive by \$44, 537 and the IRR is 9.47%. As the capacity factor moves from 35% to 40%, the project's financial performance increases substantially with IRR rising from 9.47% to 13.43%. Projects with capacity factors of 45% are rare or unreported, but improved technology may make them possible. The figures for 50% capacity factor are listed as an interesting end point in this progression and may become relevant in the future as wind turbine technology improves.


Figure 20.

Financial Performance of 1.65 MW Wind Turbine with Capacity Factors from 25-50%

<u>Capacity Factor</u>	<u>Production(kWh)</u>	<u>Cost per kWh</u>	<u>NPV @ 9% Rate</u>	<u>IRR</u>
25%	3,613,500	\$ 0.05108	\$ (704,681)	1.31%
30%	4,336,200	\$ 0.04258	\$ (330,072)	5.45%
35%	5,058,900	\$ 0.03652	\$ 44,537	9.47%
40%	5,781,600	\$ 0.03197	\$ 419,147	13.43%
45%	6,504,300	\$ 0.02843	\$ 793,756	17.32%
50%	7,227,000	\$ 0.02560	\$ 1,168,365	21.17%

Figure 21 graphically displays the relationship between capacity factor and internal rates of return for the wind turbines with the assumptions established. The relationship is linear because we are using capacity factor.

Figure 21.

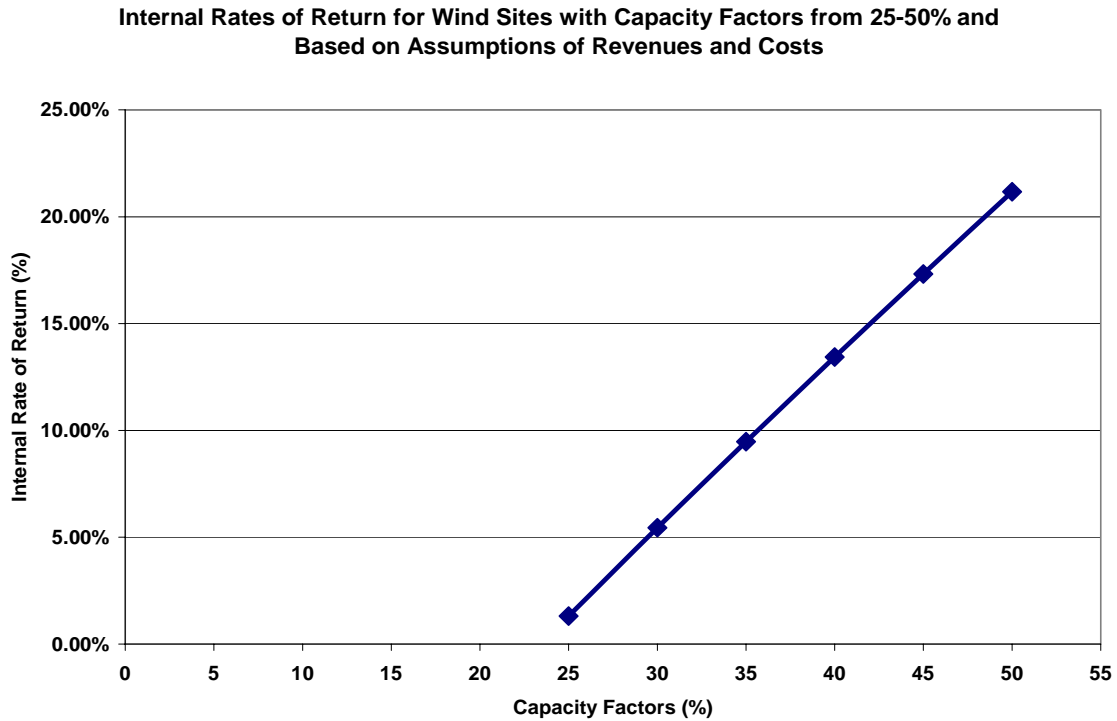

Production Economics of Diesel Gensets Alone with Biodiesel Credit

The “Genset” spreadsheet was used to determine some of the same financial performance measures that were computed with the wind turbine. In the case of the diesel genset, it was necessary to specify that the biodiesel blend is B75, which is the accepted blend for renewable definitions. In addition, biodiesel and petro-diesel were each considered to be priced at \$1.80. This is in keeping with the pricing for biodiesel that will result due to the Biodiesel Tax Credit. **Figure 22** contains figures that allow one to see how the financial performance of the project changes as more and more hours of genset usage occur in a year’s time.

Figure 23 graphically shows how IRR drops with increasing annual hours of usage, while **Figure 24** graphically shows the changes in cost per kilowatt hour produced by the diesel genset using B75 and both fuels priced at \$1.80 per gallon. As the hours of annual operation go up, the cost per kWh goes up. **Figures 22, 23 and 24** will all be different if the assumptions for price of diesel fuel and biodiesel are changed. It is reasonable to calculate those changes that would occur if higher prices for biodiesel should occur after 2008 if the Biodiesel Tax Credit ends. Instead of presenting this analysis for various biodiesel price levels in the case of a diesel genset operating along, that analysis will be presented following the case of a wind turbine complemented by a biodiesel powered genset.

Figure 22.

Cost per KiloWatt-hour of Electricity Produced by Diesel Genset Using B75 and Operating Various Hours per Year Using Petro-Diesel @\$1.80 and Biodiesel @\$1.80

Capacity %	Hours	KWH Produced	Cost/KWH	NPV	IRR	Fuel Used @B75		
						Diesel	Biodiesel	Total Fuel
1	87.6	144,540	0.42749	\$ 46,800	10.24%	2,495	7,484	9,979
2	175.2	289,080	0.24826	\$ 37,514	10.00%	4,989	14,968	19,958
3	262.8	433,620	0.18852	\$ 28,228	9.75%	7,484	22,452	29,936
4	350.4	578,160	0.15865	\$ 18,942	9.51%	9,979	29,936	39,915
5	438.0	722,700	0.14073	\$ 9,655	9.26%	12,473	37,420	49,894
6	525.6	867,240	0.12878	\$ 369	9.01%	14,968	44,904	59,873
7	613.2	1,011,780	0.12025	\$ (8,917)	8.76%	17,463	52,388	69,851
8	700.8	1,156,320	0.11384	\$ (18,203)	8.51%	19,958	59,873	79,830
9	788.4	1,300,860	0.10887	\$ (27,490)	8.26%	22,452	67,357	89,809
10	876.0	1,445,400	0.10488	\$ (36,776)	8.01%	24,947	74,841	99,788
11	963.6	1,589,940	0.10162	\$ (46,062)	7.76%	27,442	82,325	109,766
12	1051.2	1,734,480	0.09891	\$ (55,349)	7.51%	29,936	89,809	119,745
13	1138.8	1,879,020	0.09661	\$ (64,635)	7.25%	32,431	97,293	129,724
14	1226.4	2,023,560	0.09464	\$ (73,921)	7.00%	34,926	104,777	139,703
15	1314.0	2,168,100	0.09293	\$ (83,207)	6.74%	37,420	112,261	149,681
20	1752.0	2,890,800	0.08696	\$ (129,639)	5.45%	49,894	149,681	199,575
30	2628.0	4,336,200	0.08099	\$ (222,501)	2.77%	74,841	224,522	299,363
39.66	3473.8	5,731,793	0.07808	\$ (312,164)	0.00%	98,928	296,784	395,712
40	3504.0	5,781,600	0.07800	\$ (315,364)	-0.10%	99,788	299,363	399,150
100	8760.0	14,454,000	0.07262	\$ (872,539)	div/0	294,469	748,407	997,876

Figure 23.

Internal Rate of Return for Various Hourly Operating of Diesel Genset using B75 and Prices @\$1.80 Petro-Diesel and \$1.80 Biodiesel


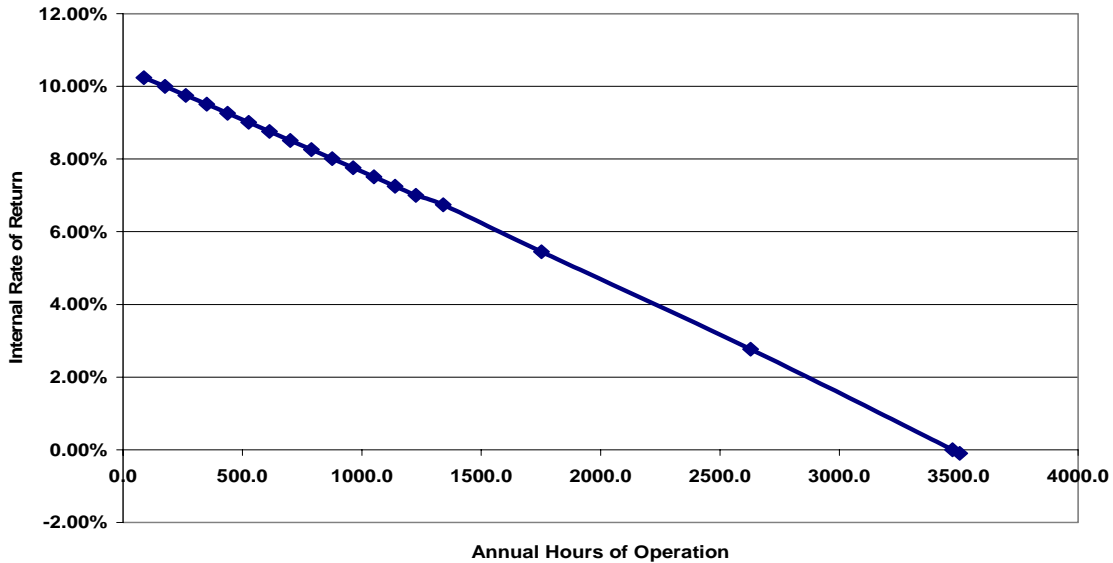


Figure 24.

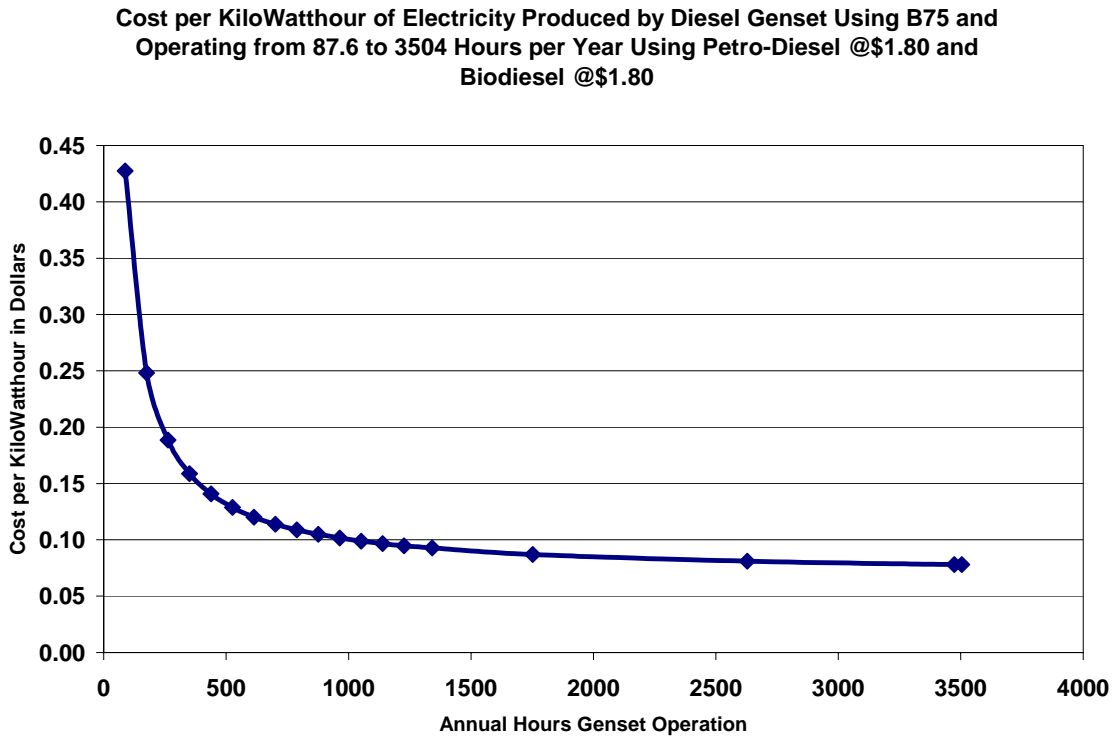

Production Economics of Hybrid System with Biodiesel Tax Credit

The next stage in the analysis is to combine the operation of a wind turbine with a diesel genset and determine the financial effects of various factors such as capacity factor of wind site, number of hours or capacity required of the genset to reach “firm” power level of 65% during the key on-peak periods June-September, and the costs of diesel and biodiesel used in a B75 blend. The first set of analyses will conform to the current status with price of biodiesel equal to the price of petro-diesel through the use of the Biodiesel Tax Credit.

Figure 25 is a table that contains financial performance of running a biodiesel genset to complement a wind site with a 30% capacity factor using a B75 fuel blend with biodiesel and petro-diesel each costing \$1.80 per gallon. According to previous analysis using the model developed, a wind site with 30% capacity has a NPV of -\$330,072 with standard operating assumptions as shown in **Figure 20**. The presence and utilization of a diesel genset will not improve profitability, if one considers that operation of the genset will have to exceed 7% or more in order to reach the threshold for “firm” power and the payments for capacity. All NPV’s for various levels of genset usage on a 30% wind site are negative, and higher usage of the genset with its higher operating costs producing more expense kilowatt-hours only makes the situation more unprofitable.

Figure 25.

Financial Performance of Wind Turbine on 30% Capacity Site Complemented by Genset with Diesel/ Biodiesel Prices (\$1.80/\$1.80) for Various Amounts of Genset Operation

<u>%</u>	<u>Hours</u>	<u>Diesel Price</u>	<u>Biodiesel Price</u>	<u>NPV</u>	<u>Cost/KWH</u>	<u>IRR</u>	<u>KWH Produced</u>
1	87.6	1.80	1.80	\$ (283,272)	\$ 0.05500	6.85%	4,480,740
2	175.2	1.80	1.80	\$ (292,558)	\$ 0.05544	6.78%	4,625,280
3	262.8	1.80	1.80	\$ (301,844)	\$ 0.05585	6.70%	4,769,820
4	350.4	1.80	1.80	\$ (311,131)	\$ 0.05624	6.63%	4,914,360
5	438.0	1.80	1.80	\$ (320,417)	\$ 0.05661	6.56%	5,058,900
6	525.6	1.80	1.80	\$ (320,703)	\$ 0.05695	6.49%	5,203,440
7	613.2	1.80	1.80	\$ (338,989)	\$ 0.05728	6.41%	5,347,980
8	700.8	1.80	1.80	\$ (348,276)	\$ 0.05759	6.34%	5,492,520
9	788.4	1.80	1.80	\$ (357,562)	\$ 0.05788	6.27%	5,637,060
10	876.0	1.80	1.80	\$ (366,848)	\$ 0.05816	6.19%	5,781,600
15	1314.0	1.80	1.80	\$ (413,279)	\$ 0.05937	5.82%	6,504,300
20	1752.0	1.80	1.80	\$ (459,711)	\$ 0.06034	5.45%	7,227,000

Moving into more typical wind capacity factor levels of 35%, the addition of the genset can result in positive NPV's for the wind turbine-genset package under the assumptions of existence of the Biodiesel Tax Credit if operating hours for the genset are kept low enough. **Figure 26** contains the financial performance of a 35% wind capacity factor site and various hours of operation of the diesel genset to achieve 65% firm power that would be needed for a "qualifying facility." This example most closely conforms to the two wind sites in Petersburg and Valley City, North Dakota with the annual capacity factors near 35%.

Figure 26.

Overall Financial Performance of Wind Turbine on 35% Capacity Site Complemented by Genset with Diesel/ Biodiesel Prices (\$1.80/\$1.80) for Various Levels of Genset Operation

<u>%</u>	<u>Hours</u>	<u>Diesel Price</u>	<u>Biodiesel Price</u>	<u>NPV</u>	<u>Cost/KWH</u>	<u>IRR</u>	<u>KWH Produced</u>
1	87.6	\$1.80	\$1.80	\$ 91,337	\$ 0.04738	9.69%	5,203,440
2	175.2	\$1.80	\$1.80	\$ 82,051	\$ 0.04796	9.62%	5,347,980
3	262.8	\$1.80	\$1.80	\$ 72,765	\$ 0.04852	9.55%	5,492,520
4	350.4	\$1.80	\$1.80	\$ 63,479	\$ 0.04904	9.48%	5,637,060
4.75	416.1	\$1.80	\$1.80	\$ 56,514	\$ 0.04942	9.43%	5,745,465
5	438.0	\$1.80	\$1.80	\$ 54,192	\$ 0.04954	9.41%	5,781,600
6	525.6	\$1.80	\$1.80	\$ 44,906	\$ 0.05002	9.34%	5,926,140
7	613.2	\$1.80	\$1.80	\$ 35,600	\$ 0.05047	9.27%	6,070,680
8	700.8	\$1.80	\$1.80	\$ 26,334	\$ 0.05090	9.20%	6,215,220
9	788.4	\$1.80	\$1.80	\$ 17,047	\$ 0.05132	9.13%	6,359,760
10	876.0	\$1.80	\$1.80	\$ 7,761	\$ 0.05171	9.06%	6,504,300
10.84	949.2	\$1.80	\$1.80	\$ -	\$ 0.05030	9.00%	6,625,102
15	1314.0	\$1.80	\$1.80	\$ (38,670)	\$ 0.05344	8.70%	7,227,000
20	1752.0	\$1.80	\$1.80	\$ (85,101)	\$ 0.05486	8.34%	7,949,700
25	2190.0	\$1.80	\$1.80	\$ (131,533)	\$ 0.05604	7.98%	8,672,400
30	2628.0	\$1.80	\$1.80	\$ (177,964)	\$ 0.05704	7.61%	9,395,100

It is significant that at 949 hours of genset operation the NPV of the combined project is choked down to zero. Recall that our estimate of the necessary number of hours needed during the key months during the prime hours of the two North Dakota wind turbines was 416 hours. Up through 525.6 annual hours (6% of the year) of genset operation, the investment and operation in that piece of equipment results in a higher overall NPV. **For wind turbines of 35% capacity factor and better, the use of biodiesel-powered gensets would be financially prudent as long as the biodiesel tax credit keeps biodiesel equal in price to petro-diesel.** Above 525.6 hours of genset operation, the operational costs detract more from the overall project's NPV. At 949.2 hours the additional financial drain results in a zero NPV for the combined project; however, our analysis of the production of the two Minnkota turbines indicates that it is very unlikely that it would be necessary to run the genset in the range of 525.6- 949.2 hours.

Higher capacity wind sites are better financial propositions for the use of the diesel genset because their project economics are so much better before the genset is added. Like the 35% capacity factor site, it is always more favorable to run the genset as little as needed to achieve the 65% firm definition. **Figures 27 and 28** show the favorable financial performance of adding biodiesel-fuelled gensets at 40% and 45% capacity wind sites, respectively--- as long as the Biodiesel Tax Credit keeps biodiesel price, essentially equal to the price of petro-diesel.

Figure 27.

Financial Performance of Wind Turbine on 40% Capacity Site Complemented by Genset with Diesel/ Biodiesel Prices (\$1.80/\$1.80) for Various Amounts of Genset Operation

<u>%</u>	<u>Hours</u>	<u>Diesel Price</u>	<u>Biodiesel Price</u>	<u>NPV</u>	<u>Cost/KWH</u>	<u>IRR</u>	<u>KWH Produced</u>
1	87.6	\$1.80	\$1.80	\$ 465,947	\$0.04162	12.54%	\$ 5,926,140
2	175.2	\$1.80	\$1.80	\$ 456,661	\$0.04227	12.47%	\$ 6,070,680
3	262.8	\$1.80	\$1.80	\$ 447,374	\$0.04289	12.40%	\$ 6,215,220
4	350.4	\$1.80	\$1.80	\$ 438,088	\$0.04349	12.34%	\$ 6,359,760
5	438.0	\$1.80	\$1.80	\$ 428,802	\$0.04405	12.27%	\$ 6,504,300
6	525.6	\$1.80	\$1.80	\$ 419,516	\$0.04460	12.20%	\$ 6,648,840
7	613.2	\$1.80	\$1.80	\$ 410,229	\$0.04512	12.13%	\$ 6,793,380
8	700.8	\$1.80	\$1.80	\$ 400,943	\$0.04561	12.06%	\$ 6,937,920
9	788.4	\$1.80	\$1.80	\$ 391,657	\$0.04609	11.99%	\$ 7,082,460
10	876.0	\$1.80	\$1.80	\$ 382,371	\$0.04655	11.92%	\$ 7,227,000
15	1314.0	\$1.80	\$1.80	\$ 335,939	\$0.04860	11.58%	\$ 7,949,700
20	1752.0	\$1.80	\$1.80	\$ 289,508	\$0.05030	11.23%	\$ 8,672,400
25	2190.0	\$1.80	\$1.80	\$ 243,077	\$0.05174	10.88%	\$ 9,395,100
30	2628.0	\$1.80	\$1.80	\$ 196,645	\$0.05298	10.53%	\$ 10,117,800
51.18	4483.0	\$1.80	\$1.80	\$ -	\$0.05671	9.00%	\$ 13,178,572

Figure 28.

Financial Performance of Wind Turbine on 45% Capacity Site Complemented by Genset with Diesel/ Biodiesel Prices (\$1.80/\$1.80) for Various Amounts of Genset Operation

<u>%</u>	<u>Hours</u>	<u>Diesel Price</u>	<u>Biodiesel Price</u>	<u>NPV</u>	<u>Cost/KWH</u>	<u>IRR</u>	<u>KWH Produced</u>
1	87.6	\$1.80	\$1.80	\$ 840,556	\$ 0.03711	15.39%	6,648,840
2	175.2	\$1.80	\$1.80	\$ 831,270	\$ 0.03778	15.33%	6,793,380
3	262.8	\$1.80	\$1.80	\$ 821,984	\$ 0.03844	15.26%	6,937,920
4	350.4	\$1.80	\$1.80	\$ 812,697	\$ 0.03906	15.19%	7,082,460
5	438.0	\$1.80	\$1.80	\$ 803,411	\$ 0.03966	15.13%	7,227,000
10	876.0	\$1.80	\$1.80	\$ 756,980	\$ 0.04233	14.79%	7,949,700
15	1314.0	\$1.80	\$1.80	\$ 710,549	\$ 0.04456	14.45%	8,672,400
20	1752.0	\$1.80	\$1.80	\$ 664,117	\$ 0.04644	14.12%	9,395,100
30	2628.0	\$1.80	\$1.80	\$ 571,255	\$ 0.04945	13.43%	10,840,500
91.52	8016.8	\$1.80	\$1.80	\$ -	\$ 0.05828	9.00%	19,732,041

Production Economics of Hybrid System without Biodiesel Tax Credit

The loss of the Biodiesel Tax Credit after 2008 would increase the operating costs of the diesel gensets and would reduce the number of hours that a genset could be operated and still contribute financially to the overall project of a wind turbine and a genset. The cost for biodiesel without the credit was assumed to be approximately \$.80 more than the price of petro-diesel. This is based on the assumption that the feedstocks used for U.S. biodiesel production may eventually reach a weighting of 40% from yellow grease and 60% from soybean oil.

In the case of a 35% capacity wind site, it could tolerate just 87.6 hours of genset operation, which wouldn't be enough to capture the requirements of a qualified facility and meet the "firm power" requirement of 65% (**Figure 29**). In comparing the 35% cases with and without the Biodiesel Tax Credit, it is evident that with the tax credit, one could afford to run the genset approximately 6% more of the annual capacity and achieve the same NPV. As demonstrated in **Figure 30**, with a 40% capacity wind site it would be possible to run the genset up to 651 hours per year and have a NPV of zero for the project (which captures a 9.0% IRR). A 45% capacity factor site has the ability to tolerate a higher penetration of genset operation and still maintain the IRR of 9.0%, which is 1314 hours per year. Recall that the object for the power producers with a diesel genset complementing a wind turbine is to keep operation of the genset to a minimum as long as one is certain to meet the requirements for firm power in a qualified facility. **Figures 29, 30, and 31** contain some of the details for wind sites with capacity factors of 35%, 40% and 45%, respectively,

Figure 29.

Financial Performance of Wind Turbine on 35% Capacity Site Complemented by Genset with Diesel/ Biodiesel Prices (\$1.80/\$2.60) for Various Amounts of Genset Operation

<u>%</u>	<u>Hours</u>	<u>Diesel Price</u>	<u>Biodiesel Price</u>	<u>NPV</u>	<u>Cost/KWH</u>	<u>IRR</u>	<u>KWH Produced</u>
1.00%	87.6	\$1.80	\$2.60	\$ 36,683	\$ 0.04853	9.28%	\$ 5,203,440
2.00%	175.2	\$1.80	\$2.60	\$ (27,259)	\$ 0.05020	8.79%	\$ 5,347,980
3.00%	262.8	\$1.80	\$2.60	\$ (91,200)	\$ 0.05179	8.30%	\$ 5,492,520
4.00%	350.4	\$1.80	\$2.60	\$ (155,141)	\$ 0.05329	7.80%	\$ 5,637,060
5.00%	438.0	\$1.80	\$2.60	\$ (219,082)	\$ 0.05472	7.29%	\$ 5,781,600

Figure 30.

Financial Performance of Wind Turbine on 40% Capacity Site Complemented by Genset with Diesel/ Biodiesel Prices (\$1.80/\$2.60) for Various Amounts of Genset Operation

<u>%</u>	<u>Hours</u>	<u>Diesel Price</u>	<u>Biodiesel Price</u>	<u>NPV</u>	<u>Cost/KWH</u>	<u>IRR</u>	<u>KWH Produced</u>
1	87.6	\$ 1.80	\$ 2.60	\$ 411,292	\$ 0.04263	12.14%	\$ 5,926,140
2	175.2	\$ 1.80	\$ 2.60	\$ 347,351	\$ 0.04424	11.66%	\$ 6,070,680
3	262.8	\$ 1.80	\$ 2.60	\$ 283,410	\$ 0.04578	11.19%	\$ 6,215,220
4	350.4	\$ 1.80	\$ 2.60	\$ 219,468	\$ 0.04725	10.70%	\$ 6,359,760
5	438.0	\$ 1.80	\$ 2.60	\$ 155,527	\$ 0.04866	10.21%	\$ 6,504,300
6	525.6	\$ 1.80	\$ 2.60	\$ 91,586	\$ 0.05000	9.72%	\$ 6,648,840
7	613.2	\$ 1.80	\$ 2.60	\$ 27,645	\$ 0.05129	9.22%	\$ 6,793,380
7.43	651.1	\$ 1.80	\$ 2.60	0	\$ 0.05182	9.00%	\$ 6,855,872

Figure 31.

Financial Performance of Wind Turbine on 45% Capacity Site Complemented by Genset with Diesel/ Biodiesel Prices (\$1.80/\$2.60) for Various Amounts of Genset Operation

<u>%</u>	<u>Hours</u>	<u>Diesel Price</u>	<u>Biodiesel Price</u>	<u>NPV</u>	<u>Cost/KWH</u>	<u>IRR</u>	<u>KWH Produced</u>
1	87.6	\$1.80	\$2.60	\$ 785,901	\$ 0.03801	15.00%	6,648,840
2	175.2	\$1.80	\$2.60	\$ 721,960	\$ 0.03955	14.54%	6,793,380
3	262.8	\$1.80	\$2.60	\$ 658,019	\$ 0.04102	14.07%	6,937,920
4	350.4	\$1.80	\$2.60	\$ 594,078	\$ 0.04244	13.60%	7,082,460
5	438.0	\$1.80	\$2.60	\$ 530,137	\$ 0.04380	13.13%	7,227,000
6	525.6	\$1.80	\$2.60	\$ 466,195	\$ 0.04511	12.65%	7,371,540
7	613.2	\$1.80	\$2.60	\$ 402,254	\$ 0.04637	12.17%	7,516,080
8	700.8	\$1.80	\$2.60	\$ 338,313	\$ 0.04758	11.68%	7,660,620
9	788.4	\$1.80	\$2.60	\$ 274,372	\$ 0.04874	11.18%	7,805,160
10	876.0	\$1.80	\$2.60	\$ 210,431	\$ 0.04986	10.69%	7,949,700
13.29	1164.3	\$1.80	\$2.60	\$ -	\$ 0.05328	9.00%	8,425,382
15	1314.0	\$1.80	\$2.60	\$ (109,275)	\$ 0.05491	8.09%	8,672,400

Conclusions

It is technically possible to complement the electrical power production of individual or groups of wind turbines with diesel gensets. By complementing the variable nature of wind during the key summer months June-September, it is possible to produce “firm” power for 65% of the “On-Peak” hours, which are 9:00 a.m. to 9:00 p.m., Monday through Friday, except holidays. Efforts to build hybrid systems to complement wind should make wind a more attractive choice at higher penetration levels. However, there is no assurance that power companies will offer rates with adequate capacity payments for periods longer than a year. It will be difficult to establish and finance the purchase of a genset without some guarantee of payment rates for capacity and per kilowatt-hour.

Current annual tariffs posted by Xcel Energy and perhaps other power companies permit economic returns for hybrid systems with wind sites possessing capacity factors greater than 35% as long as biodiesel prices are equal to #2 diesel prices. Project economics for wind sites with capacity factors of 30% are not improved by the additional capital cost and operating expense of biodiesel gensets.

The federal Biodiesel Tax Credit, which offers a credit of \$1.00 per gallon for vegetable sources of oil and \$.50 per gallon for recycled yellow grease will keep the two fuels approximately equal in price as they comprise B75 blends of biodiesel. If the Biodiesel Tax Credit is removed after 2008, effective prices of biodiesel can be expected to rise. Only wind sites with capacity factors of 40% or better will be able to economically operate their gensets sufficient hours to fulfill the definitions of “firm” power during “On-Peak” hours.

Wind data utilized in this study reflected capacity factors near 35% for identical wind turbines. From the hourly wind data of the months of June-September of 2003 and 2004, we calculated the need to run the genset for 416 “On-Peak” hours. It is unknown to what extent the number of hours of genset operation would be lowered on sites with capacity factors of 40% or even 45%.

The concept of hybrid electrical generation systems has been researched by others, especially in instances serving remote locations with critical needs and expensive fuel supplies. Diesel gensets have low capital costs, and that is fortunate based on the low number of hours they may need to be operated. On the other hand, their operating expenses are high, so it is advantageous to keep their hours of operation to a minimum.

This project investigated the technical solution of adding a diesel genset to complement variable flows of power from wind turbines, especially during the “On-Peak” hours of the key summer months when most areas of the U.S. face peak loads. There may be other technical solutions such as natural gas powered engines of larger scale that may be able to complement many more wind turbines, but that question is beyond the scope of this project.